FIXED SPEED SERIES - 50 HERTZ

2017 SERVICE MANUAL

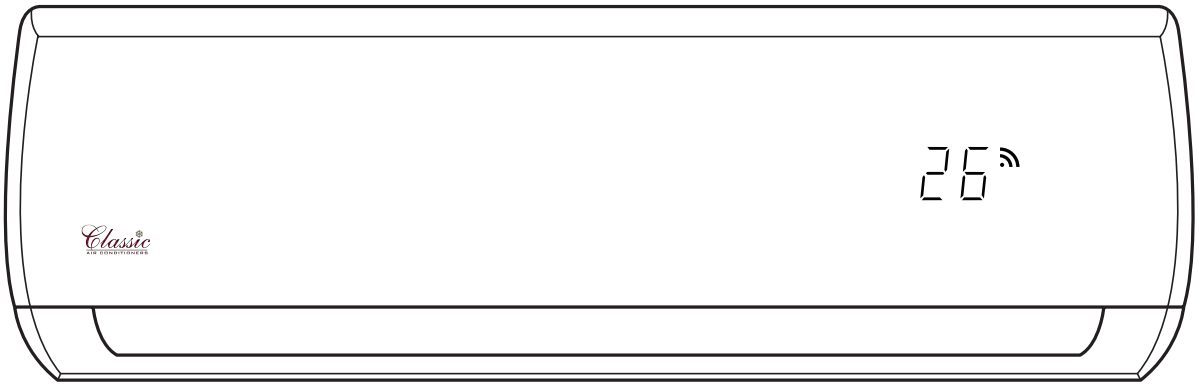

Table of Contents

Page

1. Safety Precautions 1

1. In case of Accidents or Emergency
2. Pre-Installation and Installation
3. Operation and Maintenance

2. Specifications 3

1. Model Reference
2. Electrical Wiring Diagrams

3. Product Features 9

1. Operation Modes and Functions

4. Maintenance and Disassembly 13

1. Maintenance
2. Disassembly

5. Troubleshooting 48

1. Safety Caution
2. General Troubleshooting
3. Error Diagnosis and Troubleshooting Without Error Code
4. Quick Maintenance by Error Code
5. Troubleshooting by Error Code

Appendix 67

i) Temperature Sensor Resistance Value Table for T1,T2,T3 and T4 (°C – K)

Safety Precautions

Contents

1. In Case of Accidents or Emergency 2
2. Pre-Installation.....2
3. Operation and Maintenance.....2

To prevent personal injury, or property or unit damage, adhere to all precautionary measures and instructions outlined in this manual. Before servicing a unit, refer to this service manual and its relevant sections.

Failure to adhere to all precautionary measures listed in this section may result in personal injury, damage to the unit or to property, or in extreme cases, death.

WARNING indicates a potentially hazardous situation which if not avoided could result in serious personal injury, or death.

CAUTION indicates a potentially hazardous situation which if not avoided could result in minor or moderate personal injury, or unit damage.

1. In case of Accidents or Emergency

WARNING

- If a gas leak is suspected, immediately turn off the gas and ventilate the area if a gas leak is suspected before turning the unit on.
- If strange sounds or smoke is detected from the unit, turn the breaker off and disconnect the power supply cable.
- If the unit comes into contact with liquid, contact an authorized service center.
- If liquid from the batteries makes contact with skin or clothing, immediately rinse or wash the area well with clean water.
- Do not insert hands or other objects into the air inlet or outlet while the unit is plugged in.
- Do not operate the unit with wet hands.
- Do not use a remote controller that has previously been exposed to battery damage or battery leakage.

CAUTION

- Clean and ventilate the unit at regular intervals when operating it near a stove or near similar devices.
- Do not use the unit during severe weather conditions. If possible, remove the product from the window before such occurrences.

2. Pre-Installation and Installation

WARNING

- Use this unit only on a dedicated circuit.
- Damage to the installation area could cause the unit to fall, potentially resulting in personal injury, property damage, or product failure.
- Only qualified personnel should disassemble, install, remove, or repair the unit.
- Only a qualified electrician should perform electri-cal work. For more information, contact your dealer, seller, or an authorized CLASSIC service center.

CAUTION

- While unpacking be careful of sharp edges around the unit as well as the edges of the fins on the condenser and evaporator.

3. Operation and Maintenance

WARNING

- Do not use defective or under-rated circuit breakers.
- Ensure the unit is properly grounded and that a dedicated circuit and breaker are installed.
- Do not modify or extend the power cable. Ensure the power cable is secure and not damaged during operation.
- Do not unplug the power supply plug during operation.
- Do not store or use flammable materials near the unit.
- Do not open the inlet grill of the unit during operation.
- Do not touch the electrostatic filter if the unit is equipped with one.
- Do not block the inlet or outlet of air flow to the unit.
- Do not use harsh detergents, solvents, or similar items to clean the unit. Use a soft cloth for cleaning.
- Do not touch the metal parts of the unit when removing the air filter as they are very sharp.
- Do not step on or place anything on the unit or outdoor units.
- Do not drink water drained from the unit
- Avoid direct skin contact with water drained from the unit.
- Use a firm stool or step ladder according to manufacturer procedures when cleaning or maintaining the unit.

CAUTION

- Do not install or operate the unit for an extended period of time in areas of high humidity or in an environment directly exposing it to sea wind or salt spray.
- Do not install the unit on a defective or damaged installation stand, or in an unsecure location.
- Ensure the unit is installed at a level position
- Do not install the unit where noise or air discharge created by the outdoor unit will negatively impact the environment or nearby residences.
- Do not expose skin directly to the air discharged by the unit for prolonged periods of time.
- Ensure the unit operates in areas water or other liquids.
- Ensure the drain hose is installed correctly to ensure proper water drainage.
- When lifting or transporting the unit, it is recommended that two or more people are used for this task.
- When the unit is not to be used for an extended time, disconnect the power supply or turn off the breaker.

Specifications

Contents

1. Model Reference 4

2. Electrical Wiring Diagrams 5

2.1 Indoor Unit 5

2.2 Outdoor Unit 7

1. Model Reference

Refer to the following table to determine the specific indoor and outdoor unit model number of your purchased equipment.

Indoor Unit Model	Outdoor Unit Model	Capacity (Btu)	Power Supply
MWFOC12S	MRFOC12DS	12k	220-240V~, 50Hz, 1Phase
MWFOC18S	MRFOC18DS	18k	
MWFOC24S	MRFOC24DS	24k	

2. Electrical Wiring Diagrams

2.1 Indoor unit

Abbreviation	Paraphrase
Y/G	Yellow-Green Conductor
ION	Positive and Negative Ion Generator
CAP	Capacitor
PLASMA	Electronic Dust Collector
to CCM Comm.Bus	Central Controller (for CAC)
X Y E	485 Communication Line
L	LIVE
N	NEUTRAL
Heater	The Electric Heating Belt of Indoor Unit
T1	Indoor Room Temperature
T2	Coil Temperature of Indoor Heat Exchanger Middle
T3	Coil Temperature of Condenser
T4	Outdoor Ambient Temperature
TH	Compressor Suction Temperature
EEV	Electirc Expansive Valve
T2B	Coil Temperature of Indoor Heat Exchanger Outlet

MWFOC12S MWFOC18S

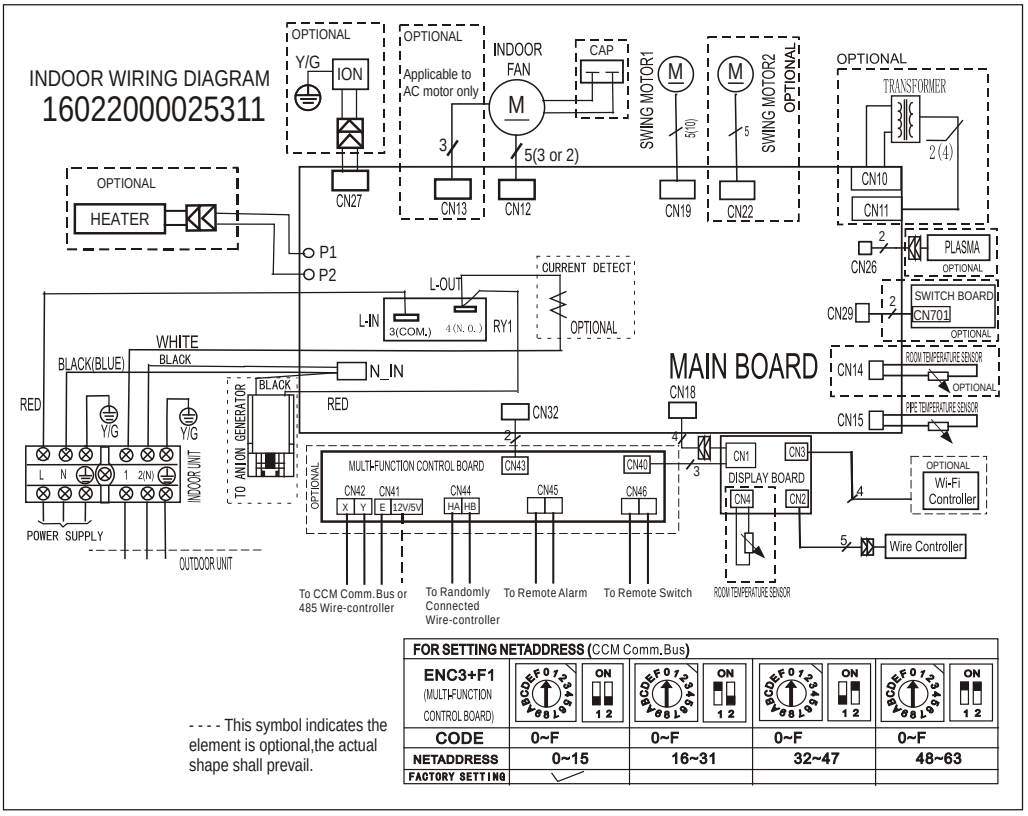

MWFOC24S

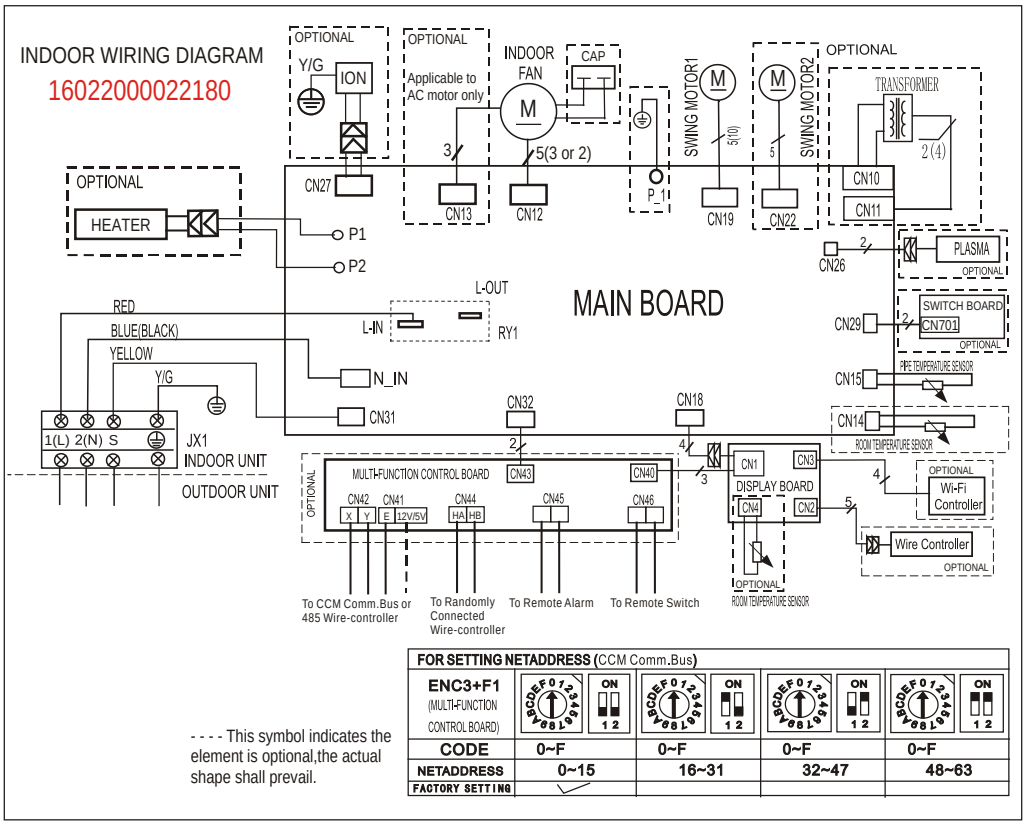

2.2 Outdoor Unit

Abbreviation	Paraphrase
4-WAY	Gas Valve Assembly/4-WAY VALVE
AC-FAN	Alternating Current FAN
DC-FAN	Direct Current FAN
CT1	AC Current Detector
COMP	Compressor
L-PRO	Low Pressure Switch
H-PRO	High Pressure Switch

MRFOC12DS; MRFOC18DS

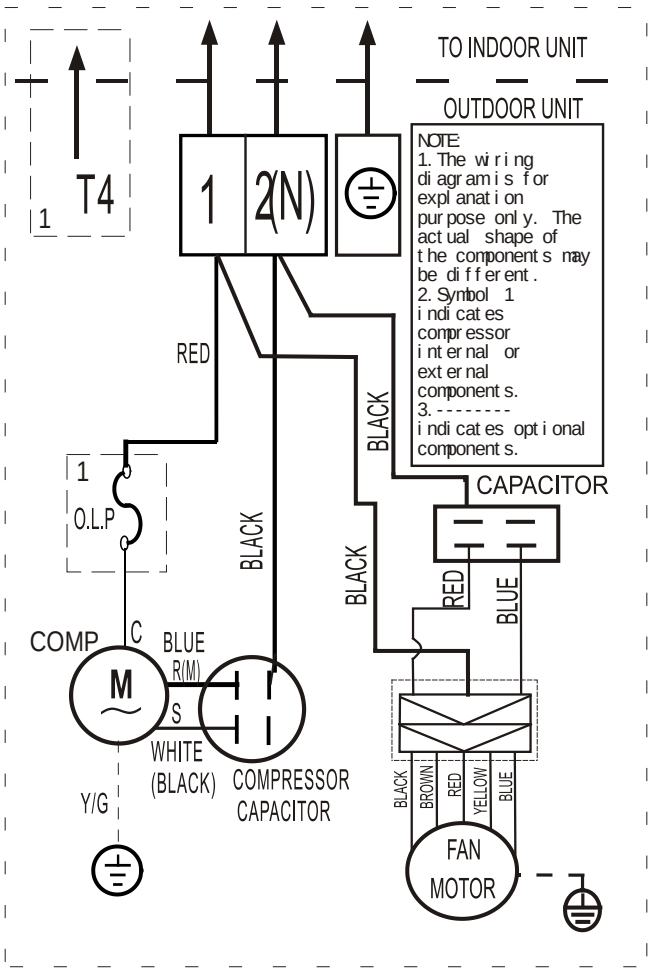

MRFOC24DS

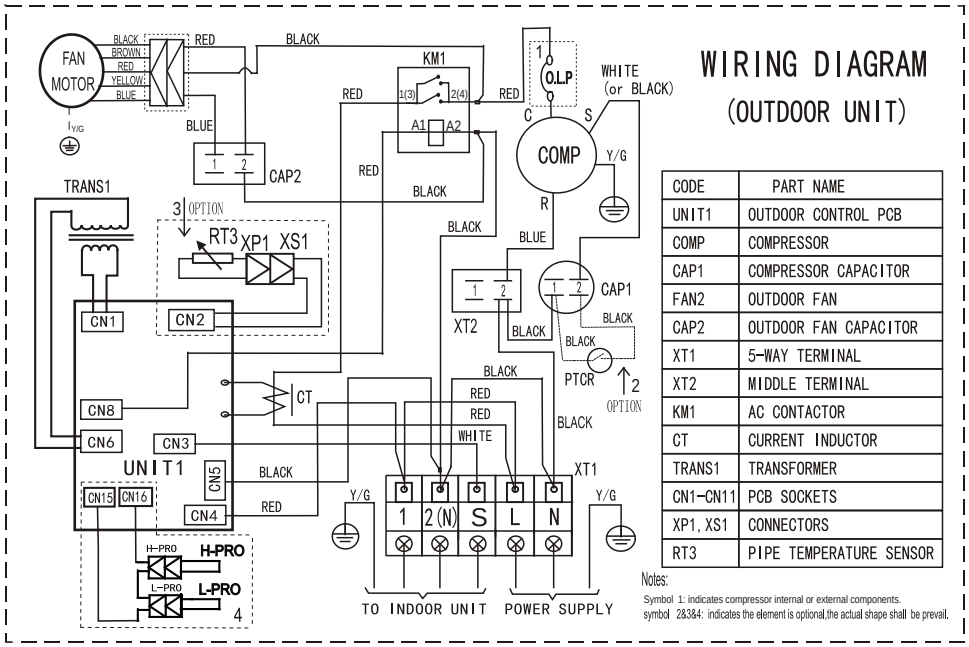

CODE	PART NAME
UNIT1	OUTDOOR CONTROL PCB
COMP	COMPRESSOR
CAP1	COMPRESSOR CAPACITOR
FAN2	OUTDOOR FAN
CAP2	OUTDOOR FAN CAPACITOR
XT1	5-WAY TERMINAL
XT2	MIDDLE TERMINAL
KM1	AC CONTACTOR
CT	CURRENT INDUCTOR
TRANS1	TRANSFORMER
CN1-CN11	PCB SOCKETS
XP1, XS1	CONNECTORS
RT3	PIPE TEMPERATURE SENSOR

Product Features

Contents

1. Operation Modes and Functions 10

1.1 Abbreviation 10

1.2 Safety Features 10

1.3 Digital Display 10

1.4 Fan Mode 11

1.5 Cooling Mode 11

1.6 Auto-mode 11

1.7 Drying Mode 11

1.8 Forced Operation Function 11

1.9 Auto-Restart Function 11

1.10 Refrigerant Leakage Detection 12

1.11 Self Clean(Optional) 12

1.12 Follow Me(Optional) 12

1.13 Information Inquiry 12

1. Operation Modes and Functions

1.1 Abbreviation

Unit element abbreviations

Abbreviation	Element
T1	Indoor room temperature
T2	Coil temperature of evaporator
T3	Coil temperature of condenser
T4	Outdoor ambient temperature

1.2 Safety Features

Compressor three-minute delay at restart

Compressor functions are delayed for up to one minute upon the first startup of the unit, and are delayed for up to three minutes upon subsequent unit restarts.

Zero crossing detection error protection

If AC can not detect zero crossing signal for 4 minutes or the zero crossing signal time interval is not correct, the unit will stop and the LED will display the failure. The correct zero crossing signal time interval should be between 6-13ms.

Automatic shutoff based on fan speed

If the indoor fan speed registers below 300RPM for 2 minutes, the unit ceases operation and the corresponding error code is displayed on the indoor unit.

Current protection

The current exceeds setting value for certain time, the compressor and outdoor fan will shut off.

Indoor fan delayed operation

- When the unit starts, the louver is automatically activated and the indoor fan will operate after a period of 4 seconds.
- If the unit is in heating mode, the indoor fan is regulated by the anti-cold wind function.

Sensor redundancy and automatic shutoff

If one temperature sensor malfunctions, the air conditioner ceases operation.

Refrigerant leakage detection

This function is active only when cooling mode is selected. It will detect if the compressor is being damaged by refrigerant leakage or by compressor overload. This is measured using the coil temperature of evaporator T2 when the compressor is in operation.

1.3 Digital Display

Unit display functions

Function	Display
Temperature	Set temperature value
Temperature (fan and Drying mode)	Room temperature
Activation of Timer ON, Fresh, Swing, Turbo, or Silent	(3s)
Cancellation of Timer OFF, Fresh, Swing, Turbo, or Silent	(3s)
Defrost	
Warming in heating mode	
Self-clean (available on select units only)	
Heating in room tempurature under 8°C	

1.4 Fan Mode

When fan mode is activated:

- The outdoor fan and compressor are stopped.
- Temperature control is disabled and no temperature setting is displayed.
- The indoor fan speed can be set to high, med, low, or auto.
- The louver operations are identical to those in cooling mode.
- Auto fan: In fan-only mode, AC operates the same as auto fan in cooling mode with the temperature set at 24°C.

1.5 Cooling Mode

1.5.1 Compressor Control

When indoor room temp. T1 is lower than setting value, the compressor and outdoor fan will shut off.

1.5.2 Indoor Fan Control

- In cooling mode, the indoor fan operates continuously. The fan speed can be set to high, medium, low, or auto.
- If the compressor ceases operations when the configured temperature is reached, the indoor fan motor operates at the minimum or configured speed.

1.5.3 Outdoor Fan Control

The On-off outdoor units have single fan speed. The outdoor fan will run following the compressor except when AC is in evaporator high temp. protection in heating mode, condenser high temp. protection in cooling mode, defrosting mode and the current protection.

1.5.4 Evaporator Temperature Protection

When evaporator temperature drops below a configured value, the compressor and outdoor fan ceases operations.

1.6 Auto-mode

- This mode can be selected with the remote controller.
- In auto mode, the machine selects cooling, heating, or fan-only mode on the basis of ΔT (ΔT =T1-Ts).

ΔT	Running mode
ΔT>2℃	Cooling
-3℃≤ΔT≤2℃	Fan-only
ΔT<-3℃	Heating*

Heating*: In auto mode, cooling only models run the fan

- AC will run in auto mode in the below cases:
  - Pressing the forced auto button.
  - If AC is off, it will run in auto mode when the timer on function is active.
  - After setting the mode, AC will run in auto mode if the compressor keeps not running for certain time.

1.7 Drying mode

- The compressor is cycled running with 10 minutes on and then 5 minutes off. The indoor fan will keep running at low speed.
- In drying mode, if room temperature is lower than 10°C, the compressor will stop and not resume until room temperature exceeds 13°C.
- The evaporator anti-freezing protection is the same as that in cooling mode.

1.8 Forced operation function

- Forced cooling mode:

The compressor and outdoor fan continue to run and the indoor fan runs at low speed. After running for 30 minutes, the AC will switch to auto mode with a preset temperature of 24°C.

- Forced auto mode:

Forced auto mode operates the same as normal auto mode with a preset temperature of 24°C.

- The unit exits forced operation when it receives the following signals:
  - Switch on
  - Switch off
  - Timer on
  - Timer off
  - Changes in:
    - mode
    - fan speed
    - sleeping mode

1.9 Auto-Restart function

- The indoor unit has an auto-restart module that allows the unit to restart automatically. The module automatically stores the current settings (not including the swing setting) and, in the case of a sudden power failure, will restore those setting automatically within 3 minutes after power returns.
- If the unit was in forced cooling mode, it will run in this mode for 30 minutes and turn to auto mode with temperature set to 24°C.

- If there is a power failure while the unit is running, the compressor starts 3 minutes after the unit restarts. If the unit was already off before the power failure, the compressor starts 1 minute after the unit restarts.

1.10 Refrigerant Leakage Detection

- With this new technology, the display area will show "EC" when the outdoor unit detects refrigerant leakage.
- When compressor is active, the value of the Coil temperature of evaporator T2 has no change or very little change.

1.11 Self clean(Optional)

- If you press "Self Clean" when the unit is in cooling or drying mode:
  - For cooling models, the indoor unit will run in low fan mode for a certain time, then ceases operation.
  - For heat pump models, the indoor unit will run in fan-only mode, then low heat, and finally in fan-only mode.
- Self Clean keeps the indoor unit dry and prevents mold growth.

1.12 Follow me(Optional)

- If you press "Follow Me" on the remote, the indoor unit will beep. This indicates the follow me function is active.
- Once active, the remote control will send a signal every 3 minutes, with no beeps. The unit automatically sets the temperature according to the measurements from the remote control.
- The unit will only change modes if the information from the remote control makes it necessary, not from the unit's temperature setting.
- If the unit does not receive a signal for 7 minutes or you press "Follow Me," the function turns off. The unit regulates temperature based on its own sensor and settings.

1.13 Information Inquiry

- To enter information inquiry status, complete the following procedure within ten seconds:
  - Press LED 3 times.
  - Press SWING 3 times.
- If you are successful, you will hear beeps for two seconds.
- Use the LED and SWING buttons to cycle through information displayed.
- Pressing LED will display the next code in the sequence. Pressing SWING will show the previous.
- The following table shows information codes. The screen will display this code for two seconds, then the information for 25 seconds.

Displayed code	Explanation	Displayed value	Meaning	Additional Notes
T1	Room temperature	-14—70	-14—70	1. All displayed temperatures use actual values. 2. All temperatures are displayed in °C regardless of remote used. 3. If the actual value exceeds the range, it will display the maximum value or minimum value.
T2	Indoor coil temperature			
T3	Outdoor coil temperature			

Maintenance and Disassembly

Contents

1. Maintenance 14

1.1 First Time Installation Check 14

1.2 Refrigerant Recharge 16

1.3 Re-Installation 17

1.3.1 Indoor Unit 17

1.3.2 Outdoor Unit 19

2. Disassembly 21

2.1 Indoor Unit 21

2.2 Outdoor Unit 33

1. Maintenance

1.1 First Time Installation Check

Air and moisture trapped in the refrigerant system affects the performance of the air conditioner by:

- Increasing pressure in the system.
- Increasing the operating current.
- Decreasing the cooling or heating efficiency.
- Congesting the capillary tubing due to ice build-up in the refrigerant circuit.
- Corroding the refrigerant system.

To prevent air and moisture from affecting the air conditioner's performance, the indoor unit, as well as the pipes between the indoor and outdoor unit, must be be leak tested and evacuated.

Leak test (soap water method)

Use a soft brush to apply soapy water or a neutral liquid detergent onto the indoor unit connections and outdoor unit connections. If there is gas leakage, bubbles will form on the connection.

Air purging with vacuum pump

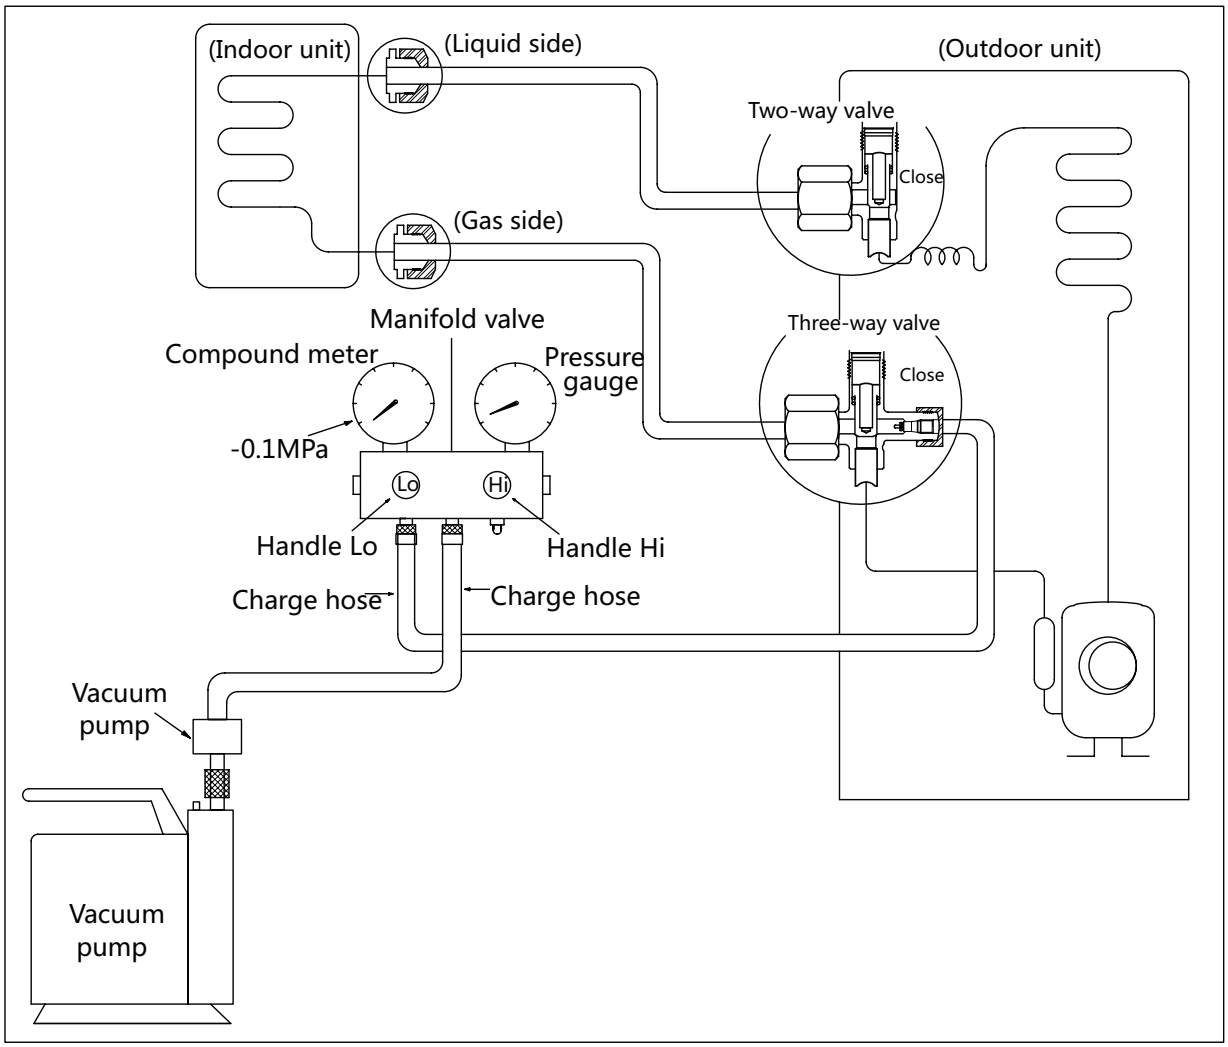

Procedure:

1. Tighten the flare nuts of the indoor and outdoor units, and confirm that both the 2- and 3-way valves are closed.
2. Connect the charge hose with the push pin of Handle Lo to the gas service port of the 3-way valve.
3. Connect the charge hose of Handle Hi connection to the vacuum pump.
4. Fully open the Handle Lo manifold valve.
5. Using the vacuum pump, evacuate the system for 30 minutes.
   a. Check whether the compound meter indicates -0.1 MPa (14.5 Psi).
      - If the meter does not indicate -0.1 MPa (14.5 Psi) after 30 minutes, continue evacuating for an additional 20 minutes.
      - If the pressure does not achieve -0.1 MPa (14.5 Psi) after 50 minutes, check for leakage.
      - If the pressure successfully reaches -0.1 MPa (14.5 Psi), fully close the Handle Lo valve and cease vacuum pump operations.
   b. Wait for 5 minutes then check whether the gauge needle moves after turning off the vacuum pump.
6. Loosen the flare nut of the 3-way valve for 6 or 7 seconds and then tighten the flare nut again.
   a. Confirm the pressure display in the pressure indicator is slightly higher than the atmospheric pressure.
   b. Remove the charge hose from the 3-way valve.
7. Fully open the 2- and 3-way valves and tighten the cap of the 3-way valve.

1.2 Refrigerant Recharge

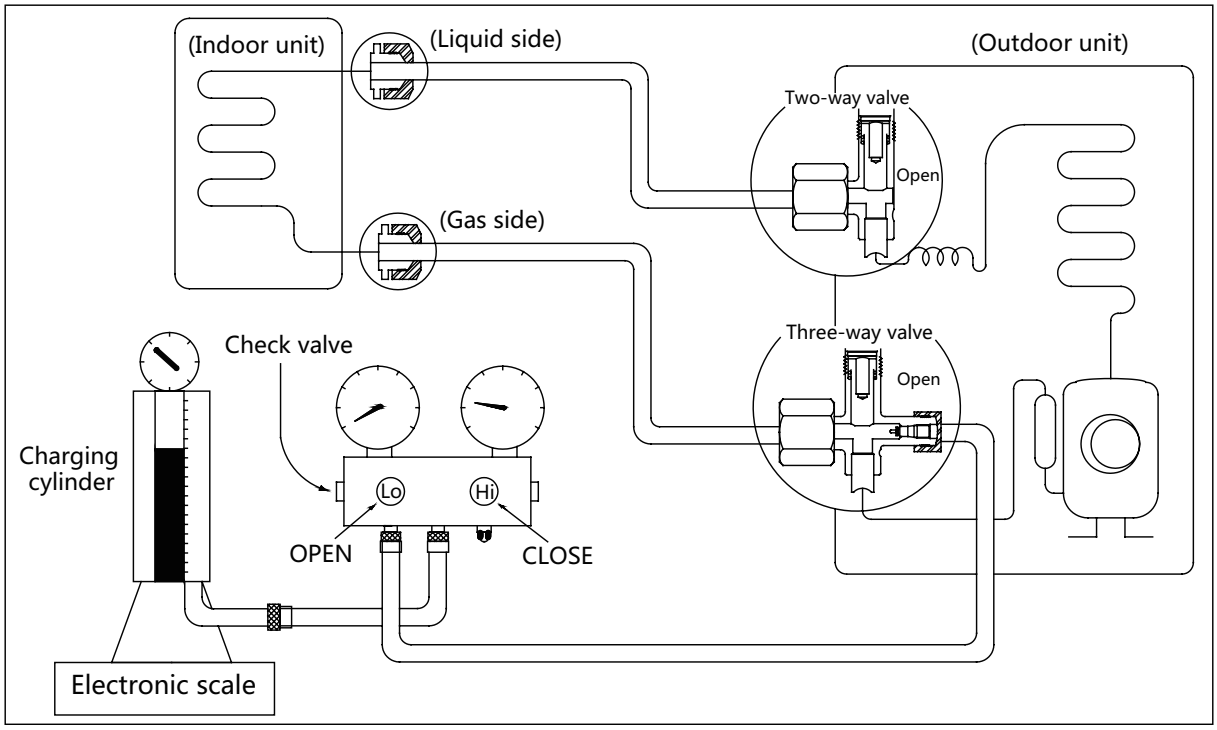

Prior to recharging the refrigerant, confirm the additional amount of refrigerant required using the following table:

Models	Standard length	Max. elevation	Max. length	Additional refrigerant
12k	5m (16.4ft)	8m (26.2ft)	20m (65.6ft)	20g/m (0.21oz/ft)
18k	5m (16.4ft)	10m (32.8ft)	25m (82ft)	20g/m (0.21oz/ft)
21k&24k	5m (16.4ft)	10m (32.8ft)	25m (82ft)	40g/m (0.42oz/ft)

Procedure:

1. Connect the charge hose to the 3-way service port and then open the 2- and the 3-way valves.
2. Connect the charge hose to the valve at the bottom of the cylinder.
3. If the refrigerant is R410A, invert the cylinder to ensure a complete liquid charge.
4. Open the valve at the bottom of the cylinder and close the check valve on the charge set to purge the air.
5. Place the charging cylinder onto an electronic scale and record the starting weight.
6. Operate the air conditioner in cooling mode.
7. Open the valves (Low side) on the charge set and charge the system with liquid refrigerant.
8. When the electronic scale displays the correct weight (refer to the gauge and the pressure of the low side to confirm), disconnect the charge hose from the 3-way valve's service port immediately and turn off the air conditioner before disconnecting the hose.
9. Mount the valve stem caps and the service port.
10. Use a torque wrench to tighten the service port cap to a torque of 18 N.m.
11. Check for gas leakage.

1.3 Re-Installation

1.3.1 Indoor Unit

Collecting the refrigerant into the outdoor unit

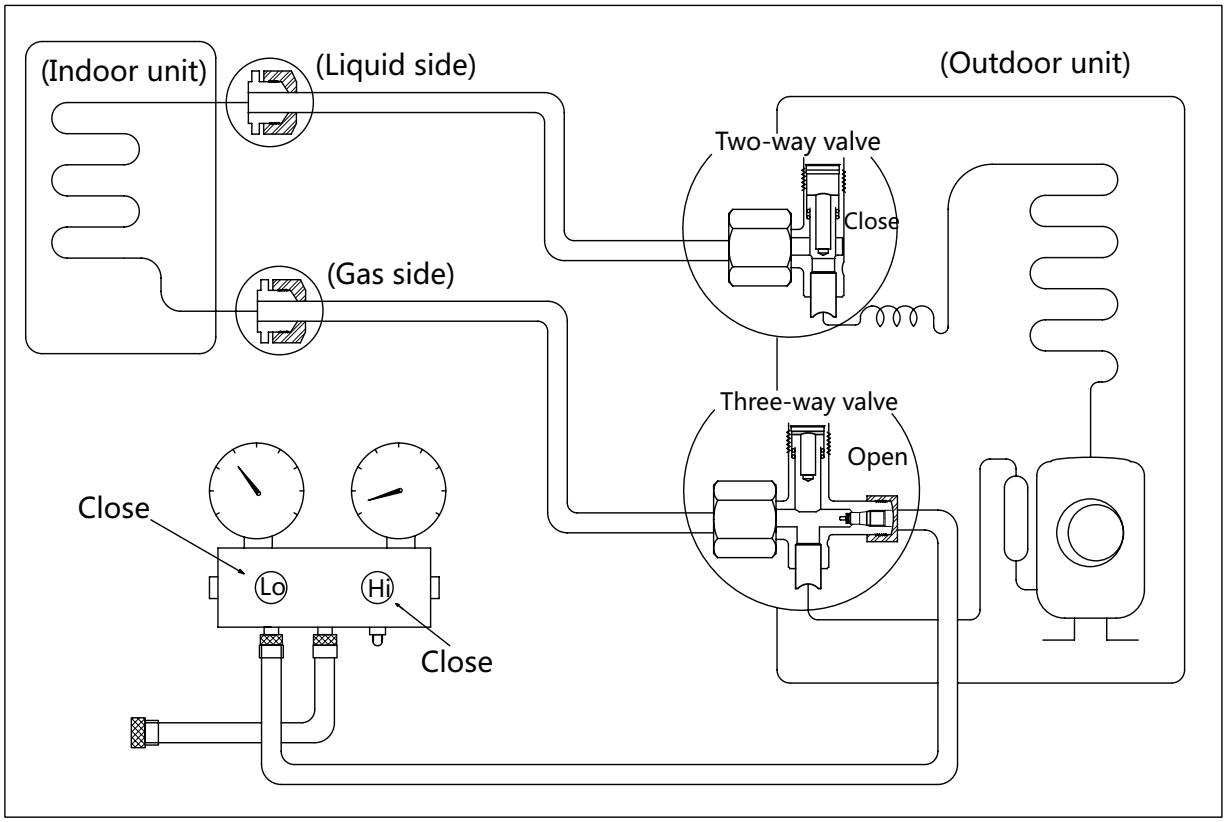

Procedure:

1. Confirm that the 2- and 3-way valves are opened.
2. Remove the valve stem caps and ensure that the valve stems are opened (use as hexagonal wrench to open the valve stems).
3. Connect the charge hose with the push pin of Handle Lo to the 3-way valve's gas service port.
4. Open the Handle Lo valve of the manifold valve to purge air from the charge hose for 5 seconds and then close it quickly.
5. Close the 2-way valve.
6. Operate the air conditioner in cooling mode. Cease operations when the gauge reaches 0.1 MPa (14.5 Psi).
7. Close the 3-way valve so that the gauge rests between 0.3 MPa (43.5 Psi) and 0.5 MPa (72.5 Psi).
8. Disconnect the charge set, and tighten the 2- and 3-way valve's stem nuts (use a torque wrench to tighten the 3-way valves service port cap to a torque of 18 N.m).
9. Check for gas leakage.

Air purging with vacuum pump

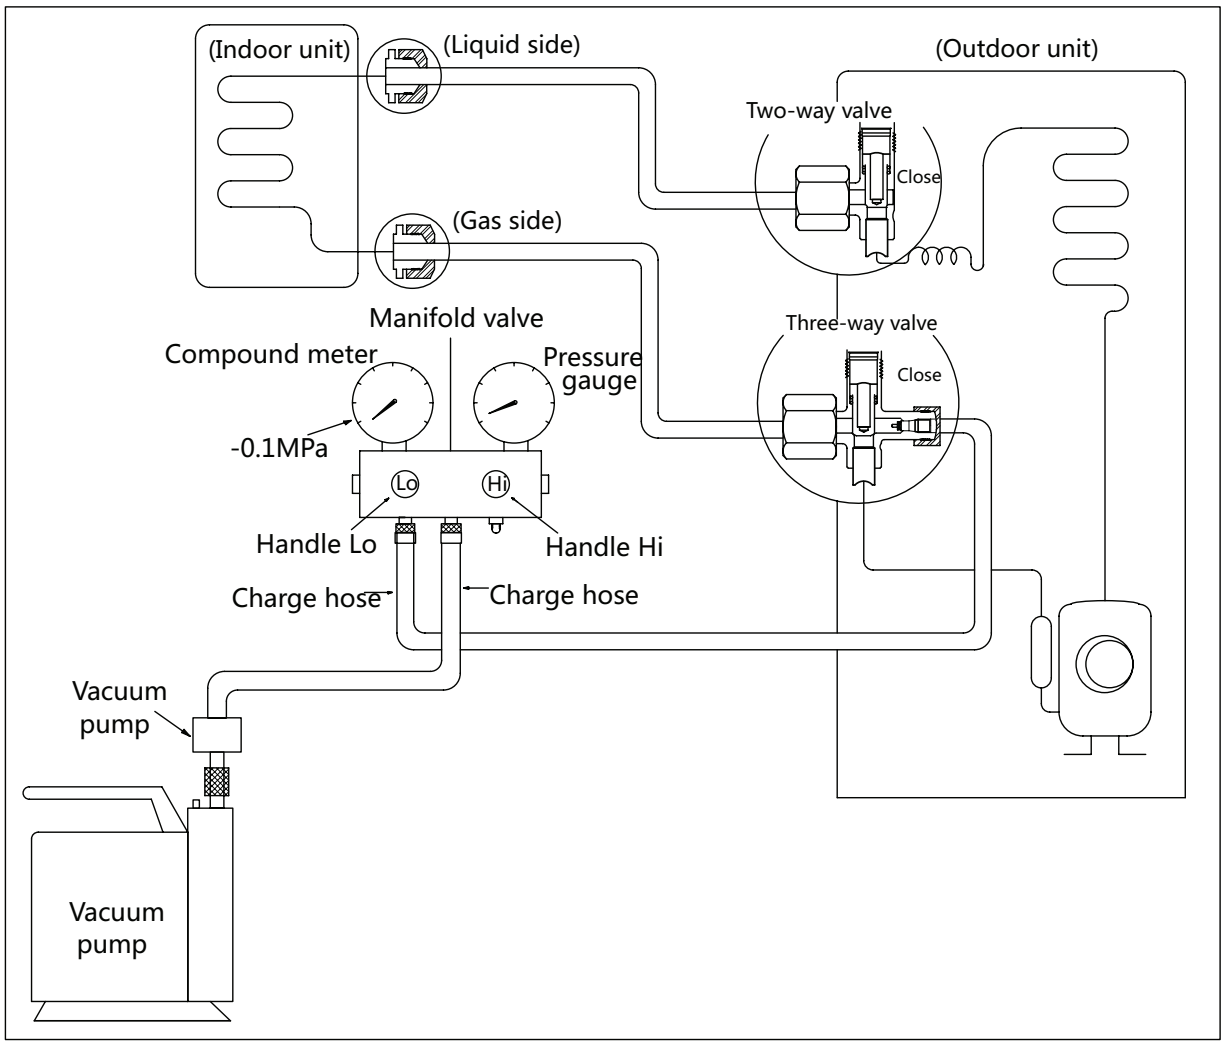

Procedure:

1. Tighten the flare nuts of the indoor and outdoor units, and confirm that both the 2- and 3-way valves are closed.
2. Connect the charge hose with the push pin of Handle Lo to the gas service port of the 3-way valve.
3. Connect the charge hose of Handle Hi connection to the vacuum pump.
4. Fully open the Handle Lo manifold valve.
5. Using the vacuum pump, evacuate the system for 30 minutes.
   a. Check whether the compound meter indicates -0.1 MPa (14.5 Psi).
      - If the meter does not indicate -0.1 MPa (14.5 Psi) after 30 minutes, continue evacuating for an additional 20 minutes.
      - If the pressure does not achieve -0.1 MPa (14.5 Psi) after 50 minutes, check for leakage.
      - If the pressure successfully reaches -0.1 MPa (14.5 Psi), fully close the Handle Lo valve and cease vacuum pump operations.
   b. Wait for 5 minutes then check whether the gauge needle moves after turning off the vacuum pump.
6. Loosen the flare nut of the 3-way valve for 6 or 7 seconds and then tighten the flare nut again.
   c. Confirm the pressure display in the pressure indicator is slightly higher than the atmospheric pressure.
   d. Remove the charge hose from the 3-way valve.
7. Fully open the 2- and 3-way valves and tighten the cap of the 3-way valve.

1.3.2 Outdoor Unit

Evacuation for the whole system

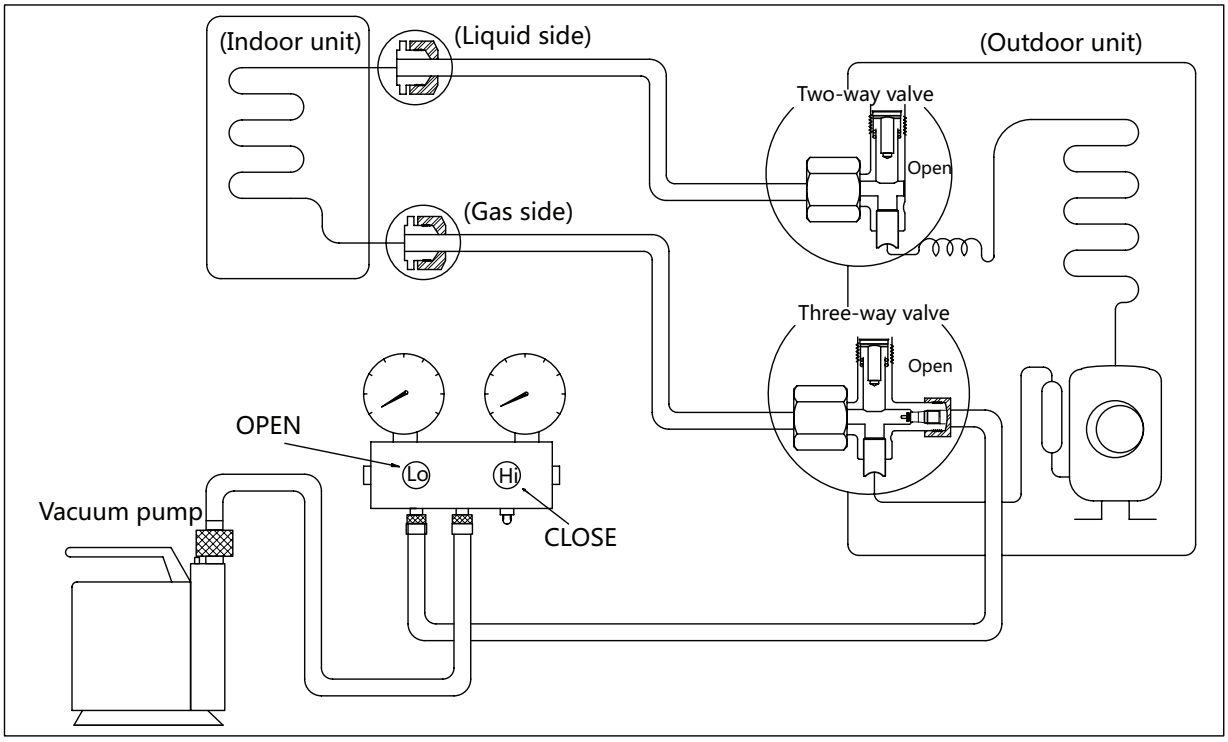

Procedure:

1. Confirm that the 2- and 3-way valves are opened.
2. Connect the vacuum pump to the 3-way valve's service port.
3. Evacuate the system for approximately one hour. Confirm that the compound meter indicates -0.1 MPa (14.5Psi).
4. Close the valve (Low side) on the charge set and turn off the vacuum pump.
5. Wait a period of five minutes then check whether the gauge needle moves after turning off the vacuum pump.
6. Disconnect the charge hose from the vacuum pump.

Refrigerant charging

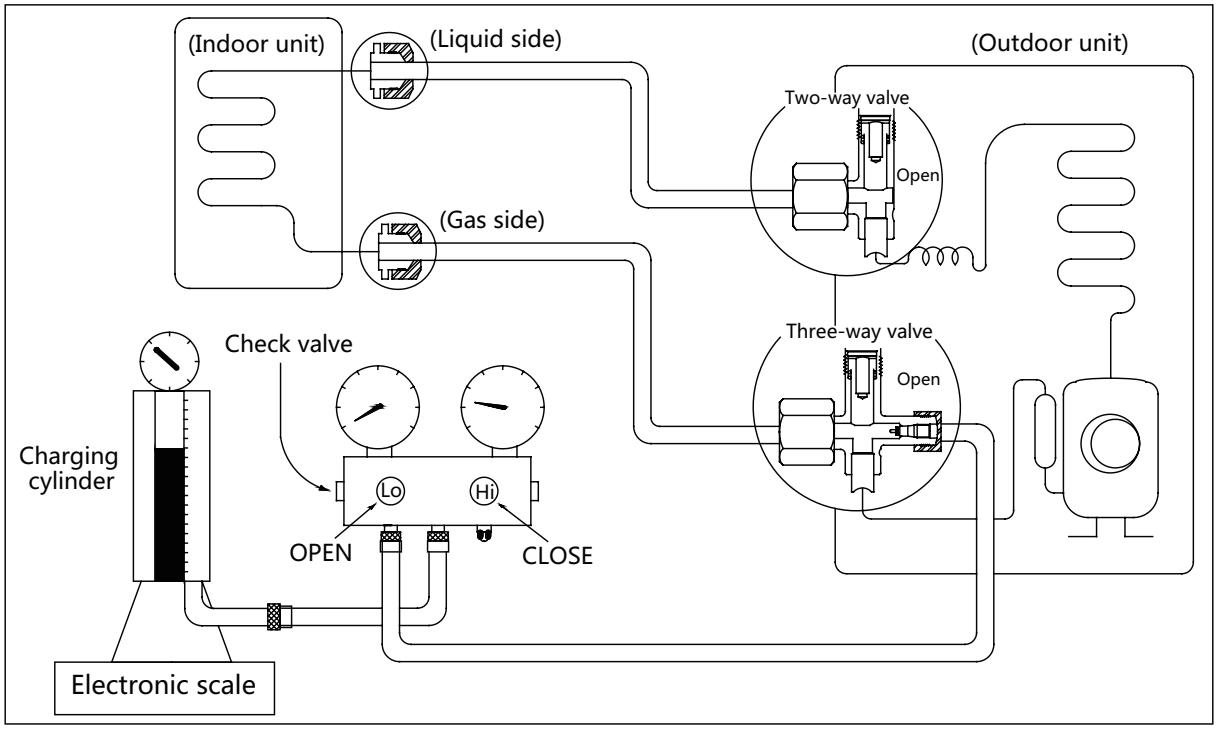

Procedure:

1. Connect the charge hose to the 3-way service port and then open the 2- and the 3-way valves.
2. Connect the charge hose to the valve at the bottom of the cylinder.
3. If the refrigerant is R410A, invert the cylinder to ensure a complete liquid charge.
4. Open the valve at the bottom of the cylinder and close the check valve on the charge set to purge the air.
5. Place the charging cylinder onto an electronic scale and record the starting weight.
6. Operate the air conditioner in cooling mode.
7. Open the valves (Low side) on the charge set and charge the system with liquid refrigerant.
8. When the electronic scale displays the correct weight (refer to the gauge and the pressure of the low side to confirm), disconnect the charge hose from the 3-way valve's service port immediately and turn off the air conditioner before disconnecting the hose.
9. Mount the valve stem caps and the service port.
10. Use a torque wrench to tighten the service port cap to a torque of 18 N.m.
11. Check for gas leakage.

Note: 1. Mechanical connectors used indoors shall comply with local regulations.

2. When mechanical connectors are reused indoors, sealing parts shall be renewed. When flared joints are reused indoors, the flare part shall be re-fabricated.

2. Disassembly

2.1 Indoor unit

1. Front Panel

Procedure	Illustration
1) Hold the front panel by the tabs on the both sides and lift it (see CJ_AF_001).	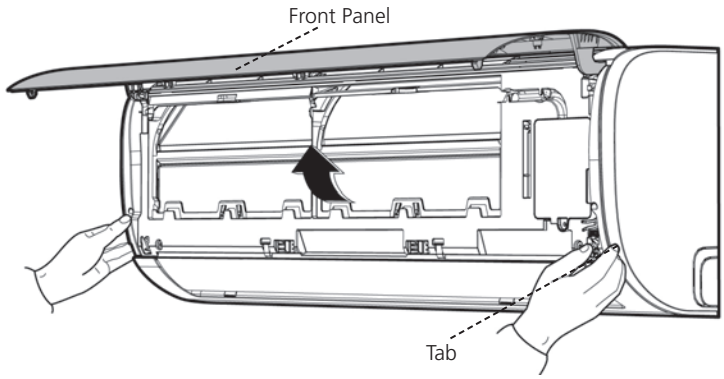 CJ_AF_001
2) Push up the bottom of an air filter, and then pull it out downwards (see CJ_AF_002).	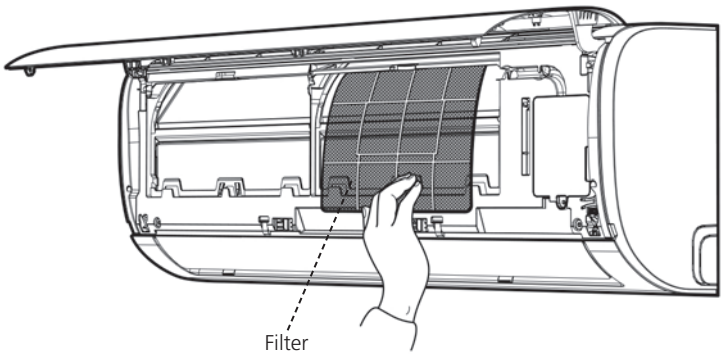 CJ_AF_002

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
3) Open the horizontal louver and push the hook towards left to open it (see CJ_AF_003).	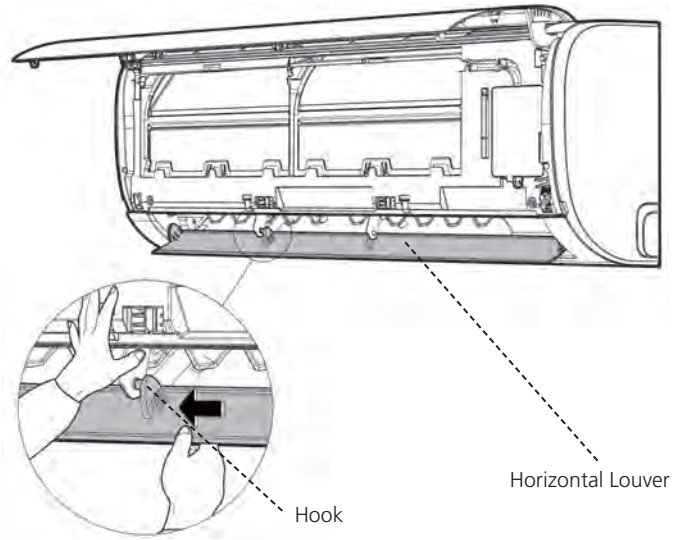 CJ_AF_003
4) Bend the horizontal louver lightly by both hands to loosen the hooks, then remove the horizontal louver (see CJ_AF_004).	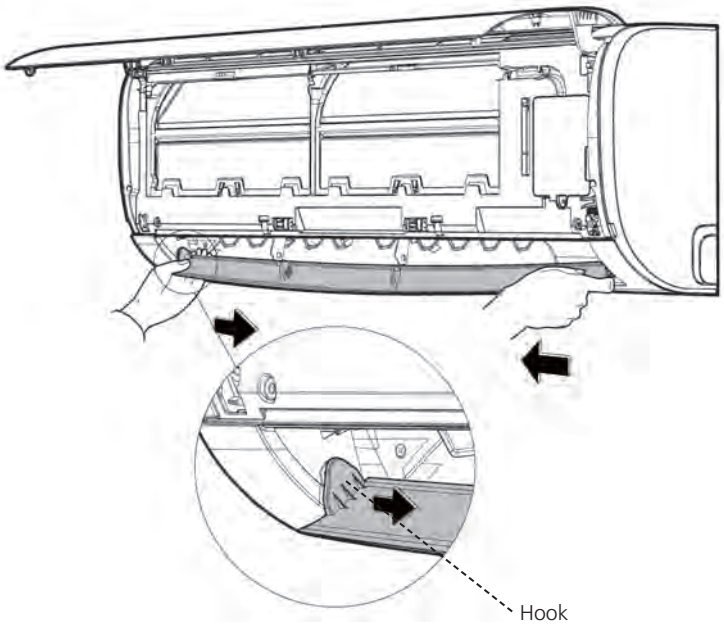 CJ_AF_004

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
5) Remove 1 screw and then remove the electrical cover(see CJ_AF_005-1 and CJ_AF_005-2). 6) Disconnect the connector for display board(see CJ_AF_005-3) . 7) Remove the display board(see CJ_AF_005-4).	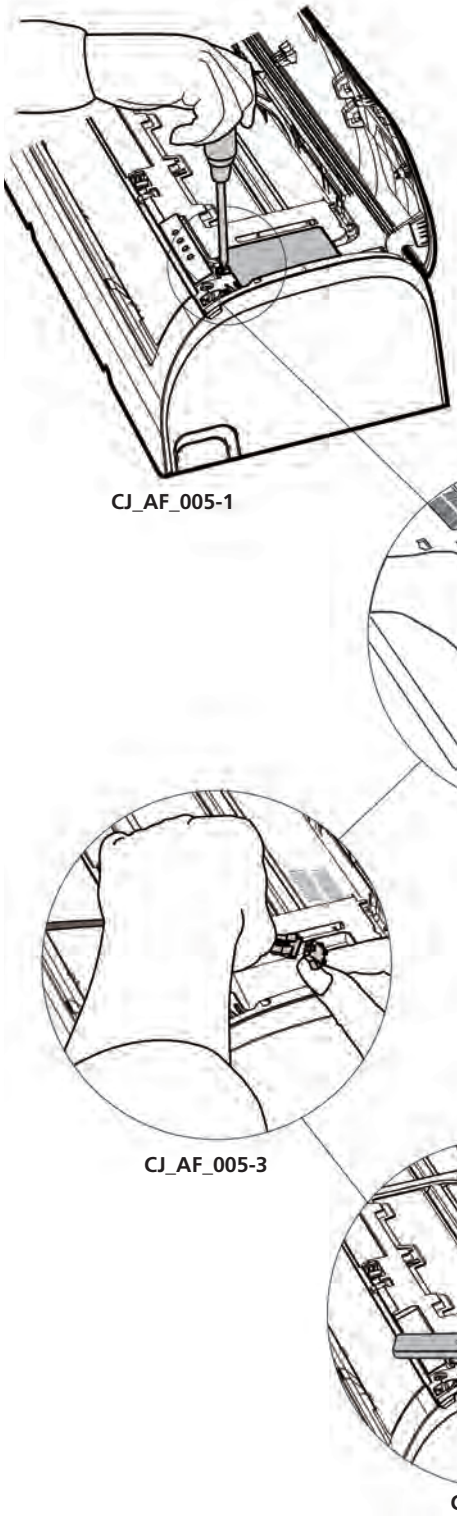 CJ_AF_005-1 CJ_AF_005-2 CJ_AF_005-3 CJ_AF_005-4 **CJ_AF_005**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
8) Open the screw caps(2) and the remove the screws(see CJ_AF_006). 9) Release the 4 hooks.	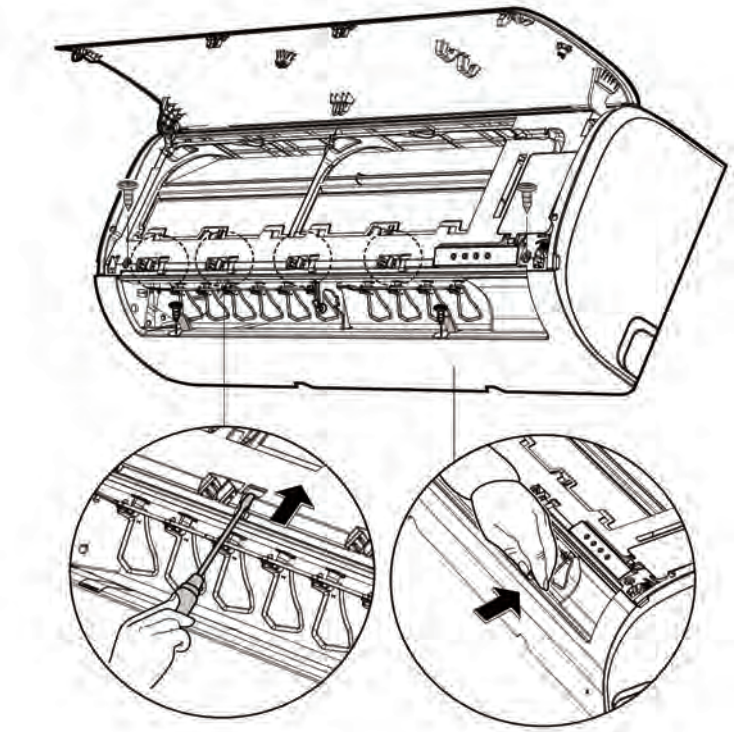 CJ_AF_006
10)Release the seven hooks in the back (see CJ_AF_007).	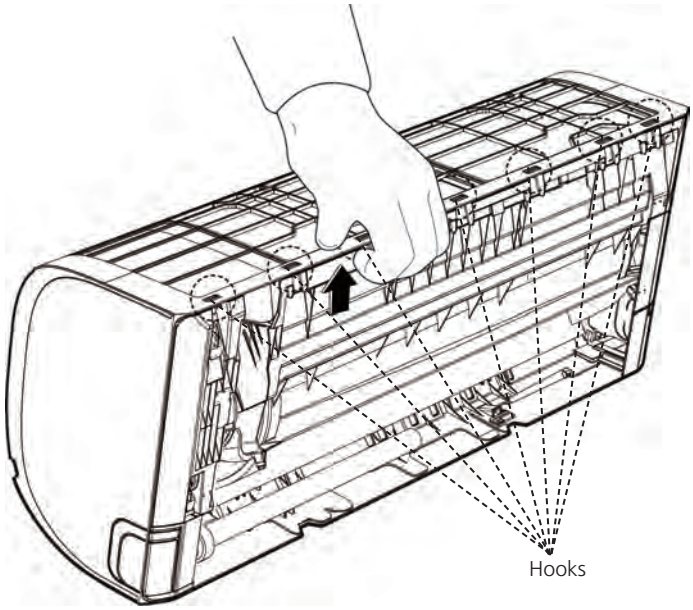 CJ_AF_007

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
11)Pull out the panel frame while pushing the hook through a clearance between the panel frame and the heat exchanger (see CJ_AF_008).	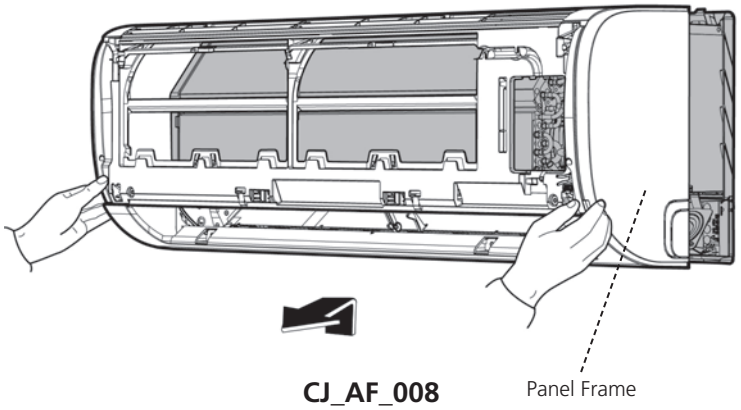 CJ_AF_008 Panel Frame

Note: This section is for reference only. Actual unit appearance may vary.

2. Electrical parts

Note: Remove the front panel (refer to 1. Front panel) before disassembling electrical parts.

Procedure	Illustration
1) Remove the fixing screw and then remove the cover of electronic box and the terminal cover (see CJ_AF_009). 2) Pull out the room temperature sensor (T1) and the coil temperature sensor (T2) (see CJ_AF_010). 3) Remove the two screws used for the ground connection (see CJ_AF_010).	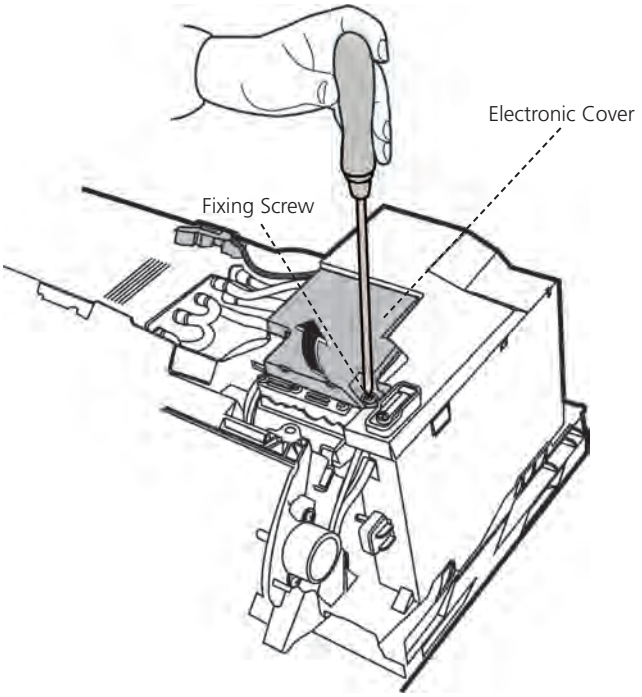 **CJ_AF_009** 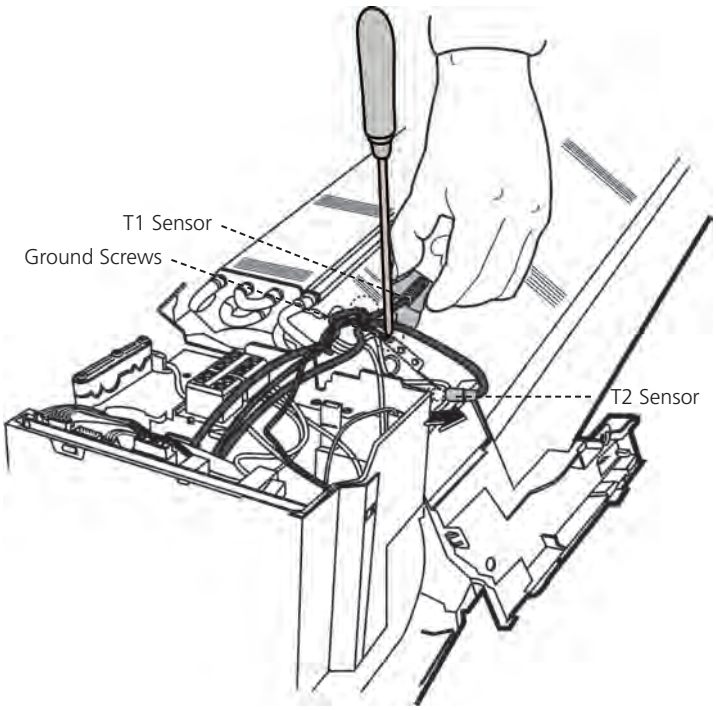 **CJ_AF_010**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
4) Remove the fixing screw (see CJ_AF_011-1). 5) Pull out the Electrical control box along the direction indicated in right image. to remove it (see CJ_AF_011-2). 6) Disconnect the wires. Then remove the electronic main board (see CJ_AF_012).	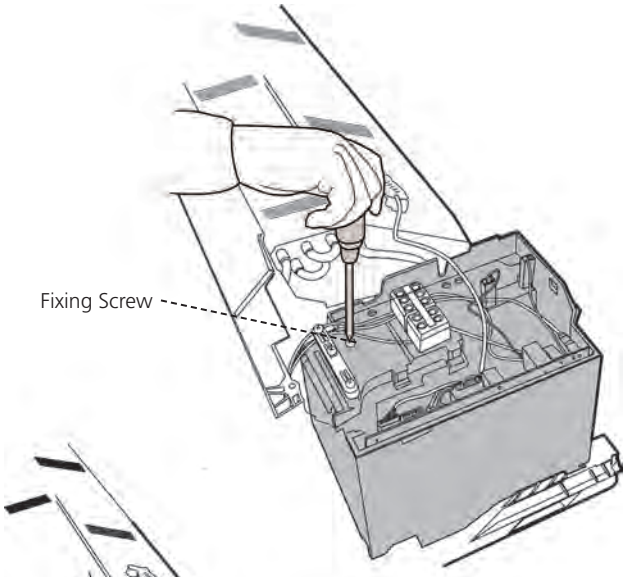 CJ_AF_011-1 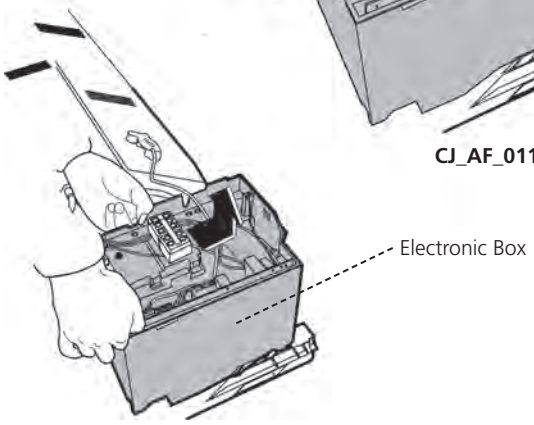 CJ_AF_011-2 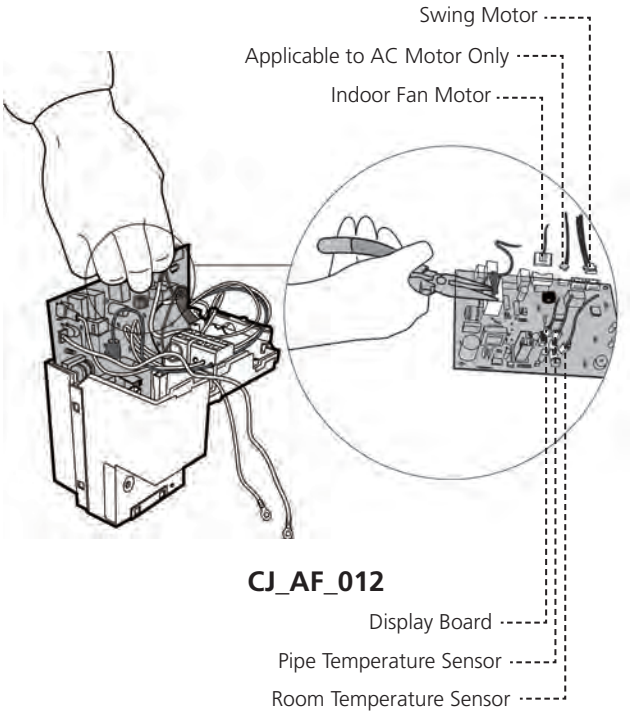 CJ_AF_012

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
7) Remove the fixing screw, then remove the capacitor of fan motor (see CJ_AF_013).	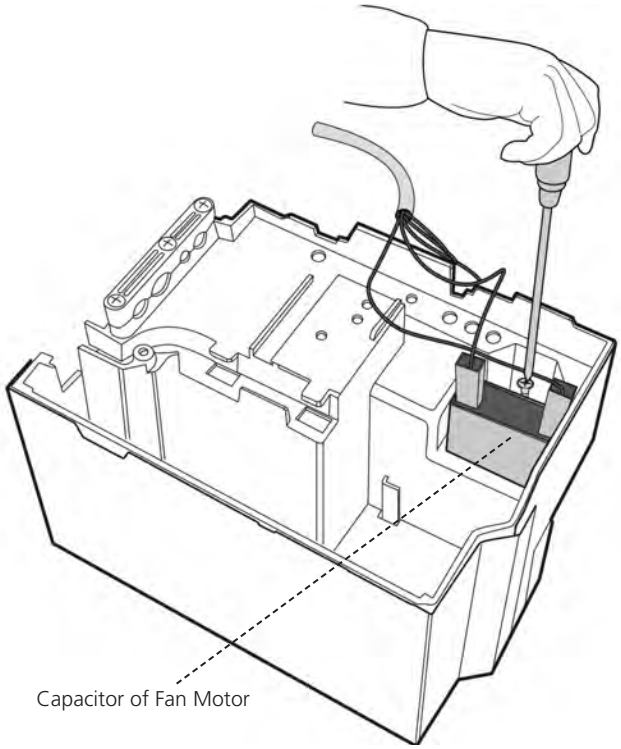 CJ_AF_013

Note: This section is for reference only. Actual unit appearance may vary.

3. Evaporator

Note: Remove the front panel and electrical parts (refer to 1. Front panel and 2. Electrical parts) before disassembling evaporator.

Procedure	Illustration
1) Disassemble the pipe holder located at the rear of the unit (see CJ_AF_014).	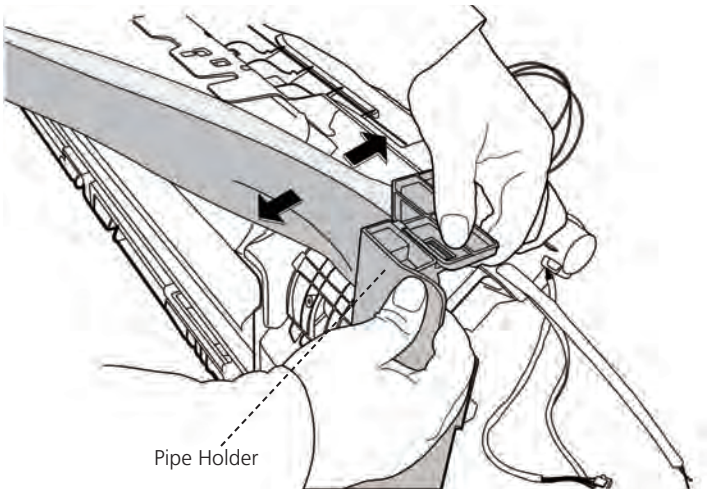 **CJ_AF_014**
2) Remove the screws on the evaporator located at the fixed plate (see CJ_AF_015).	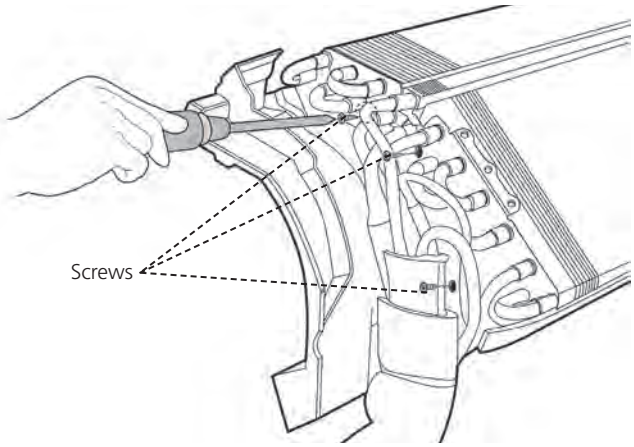 **CJ_AF_015**
3) Remove the two screws on the evaporator located at the base of the bearing side (see CJ_AF_016).	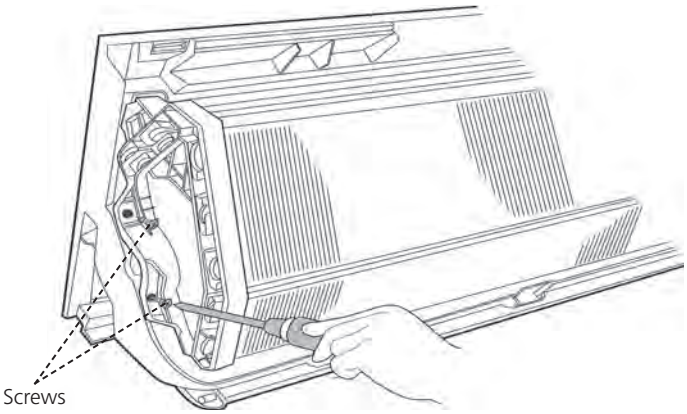 **CJ_AF_016**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
4) Pull out the evaporator (see CJ_AF_017).	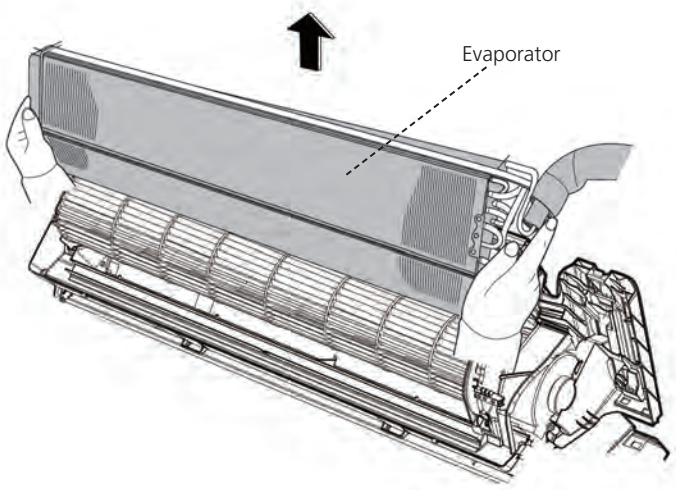 CJ_AF_017

Note: This section is for reference only. Actual unit appearance may vary.

4. Fan motor and fan

Note: Remove the front panel, electrical parts and evaporator (refer to 1. Front panel, 2. Electrical parts, and 3. Evaporator). before disassembling fan motor and fan.

Procedure	Illustration
1) Remove the two screws and remove the fixing board of the fan motor (see CJ_AF_018).	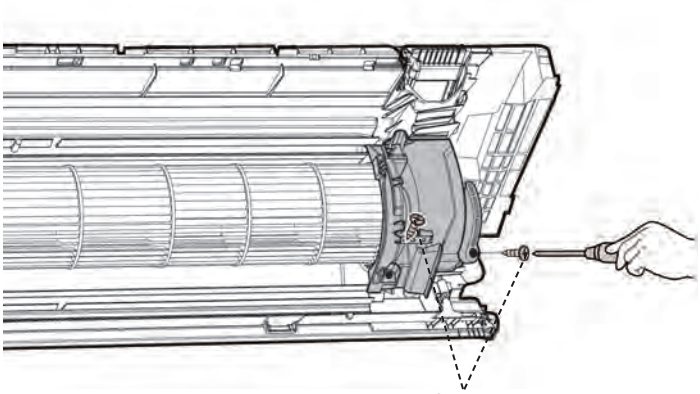 CJ_AF_018
2) Remove the Bearing sleeve(see CJ_AF_019).	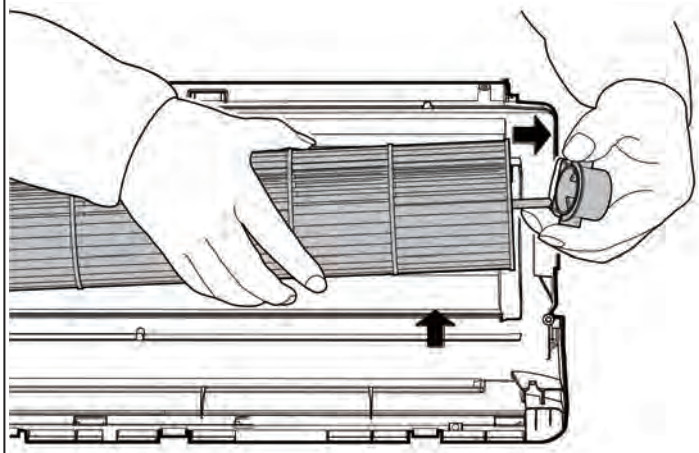 CJ_AF_019
3) Remove the fixing screw (see Fig CJ_AF_020). 4) Pull out the fan motor and fan assembly from the side.	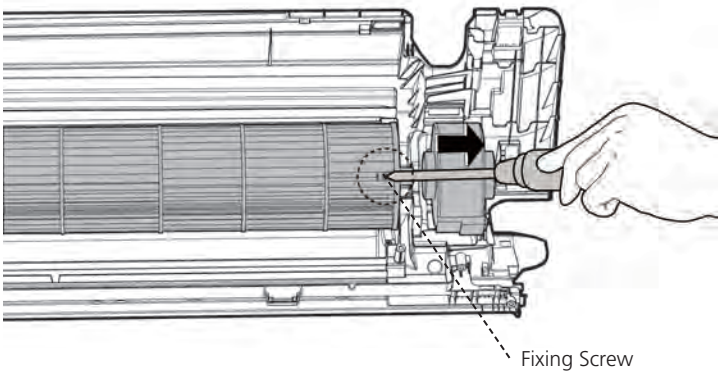 CJ_AF_020

Note: This section is for reference only. Actual unit appearance may vary.

5. Step motor

Note: Remove the front panel and electrical parts (refer to 1. Front panel, 2. Electrical parts) before disassembling step motor.

Procedure	Illustration
1) Remove the two screws, then remove the stepping motor (see CJ_AF_021).	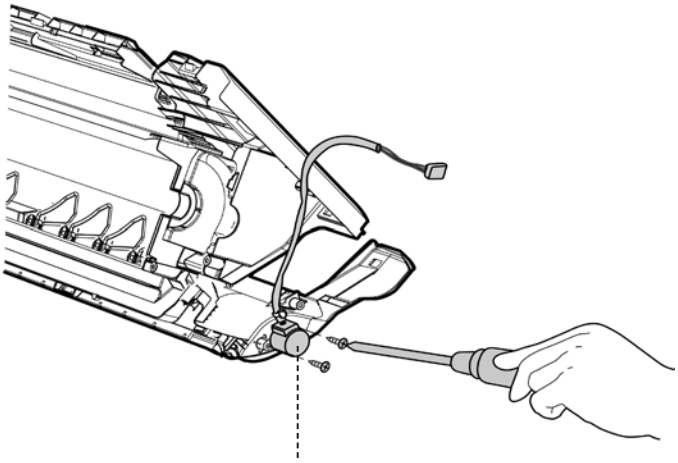 CJ_AF_021

Note: This section is for reference only. Actual unit appearance may vary.

2.2 Outdoor unit

1. Panel Plate

MRFOC12DS; MRFOC18DS

Procedure	Illustration
1) Turn off the air conditioner and the power breaker. 2) Remove the screws of the big handle and then remove the big handle (1 screws) (see CJ_BA30_001).	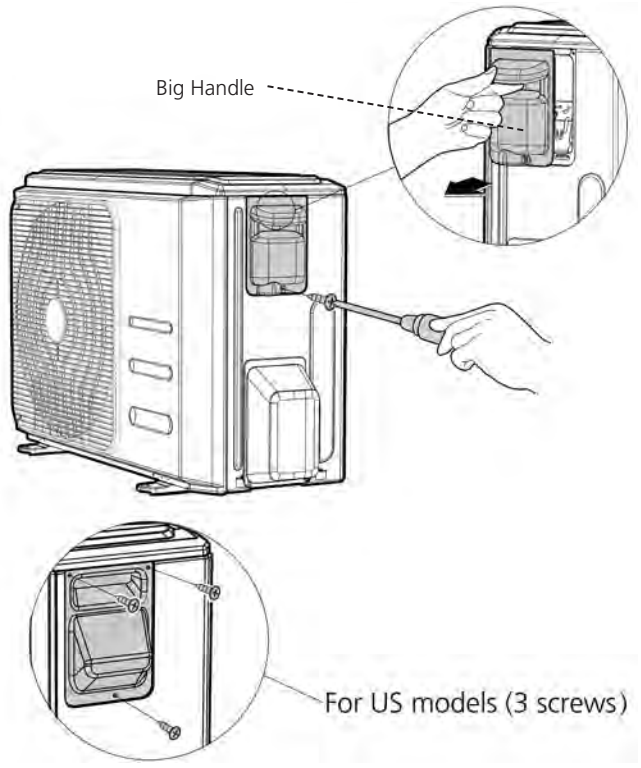 **CJ_BA30_001**
3) Remove the screws of the top cover and then remove the top cover (3 screws). One of the screws is located underneath the big handle (see CJ_ BA30_002).	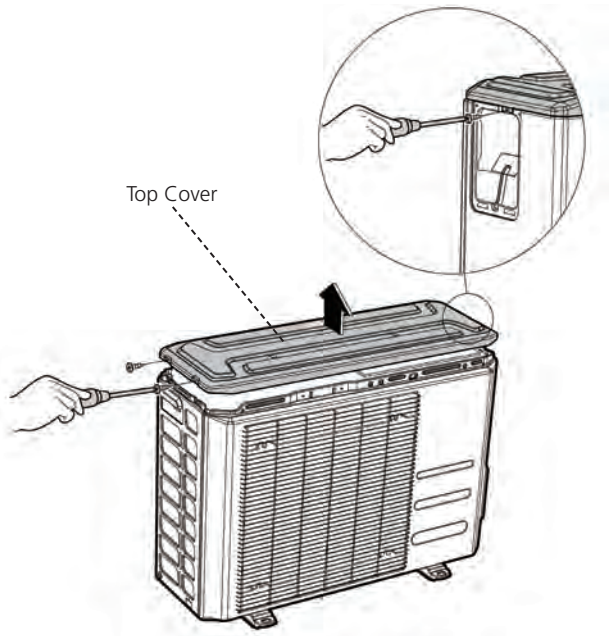 **CJ_BA30_002**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
4) Remove the screws of the front panel and then remove the front panel (7 screws) (see CJ_BA30_003).	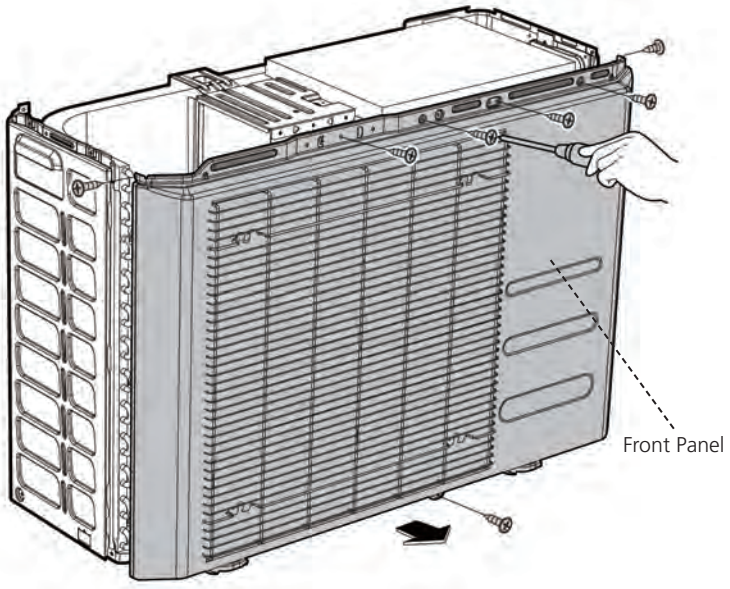 **CJ_BA30_003**
5) Remove the screws of water collecting cover (1 screw) (see CJ_BA30_004).	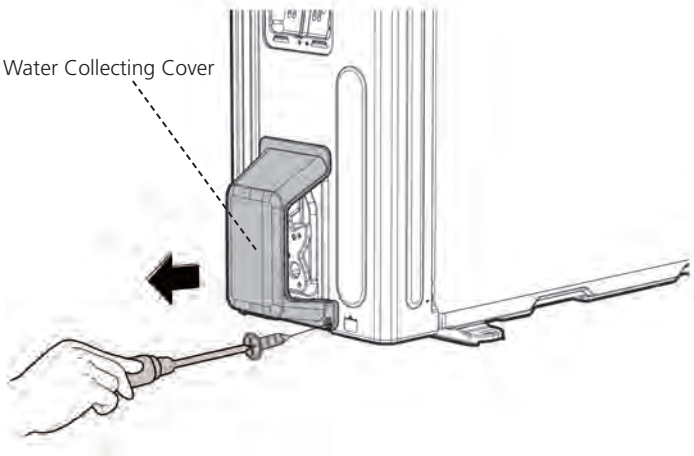 **CJ_BA30_004**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
6) Remove the screws of the rear net and then remove the rear net (2 screws) (see CJ_BA30_005).	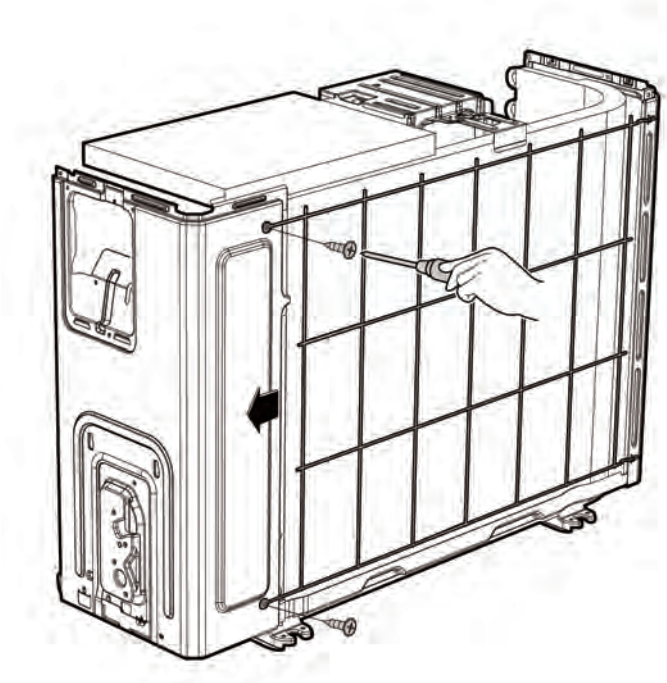 CJ_BA30_005
7) Remove the screws of the right panel and then remove the right panel (5 screws) (see CJ_BA30_006).	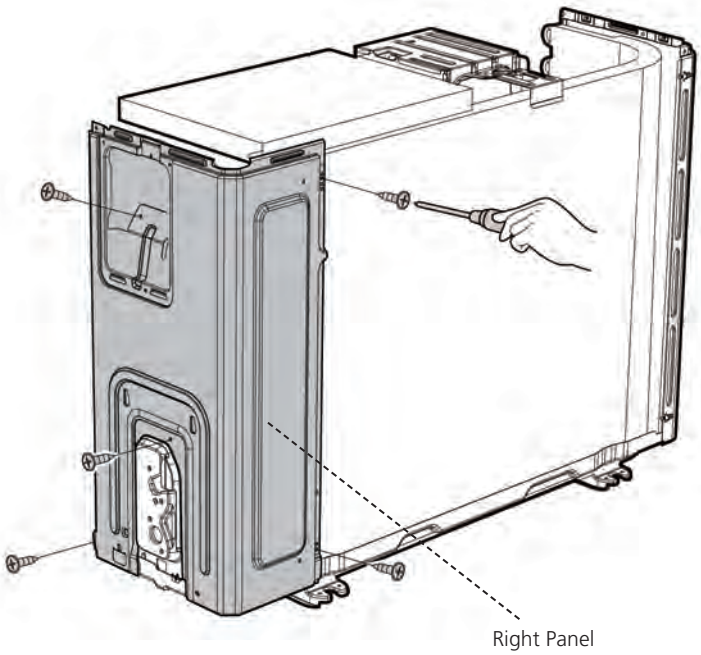 CJ_BA30_006

Note: This section is for reference only. Actual unit appearance may vary.

MRFOC24DS

Procedure	Illustration
1) Turn off the air conditioner and the power breaker. 2) Remove the screws of the big handle and then remove the big handle (1 screws) (see CJ_CA30_001). 3) Remove the screws of the top cover and then remove the top cover (3 screws). One of the screws is located underneath the big handle (see CJ_CA30_002).	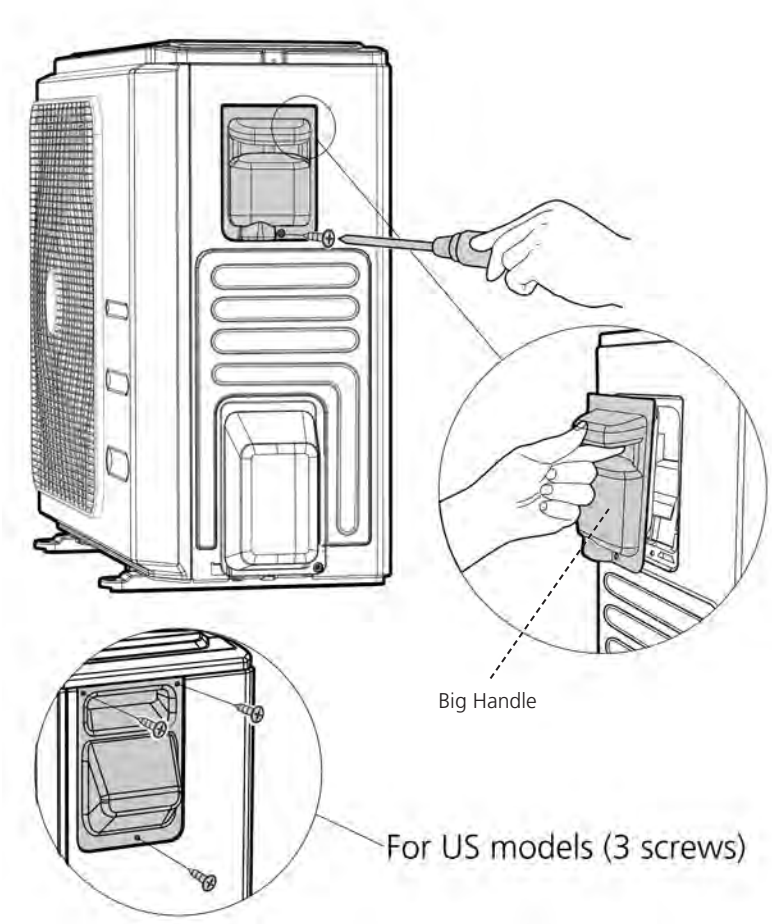 **CJ_CA30_001** 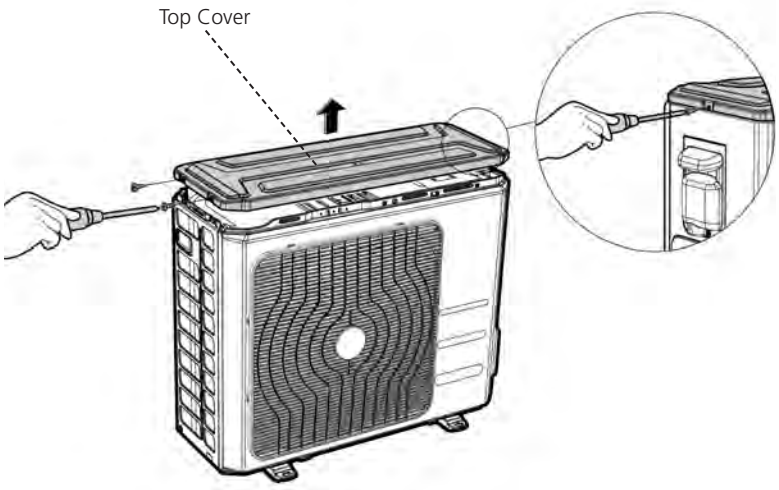 **CJ_CA30_002**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
4) Remove the screws of the front panel and then remove the front panel (6 screws) (see CJ_CA30_003).	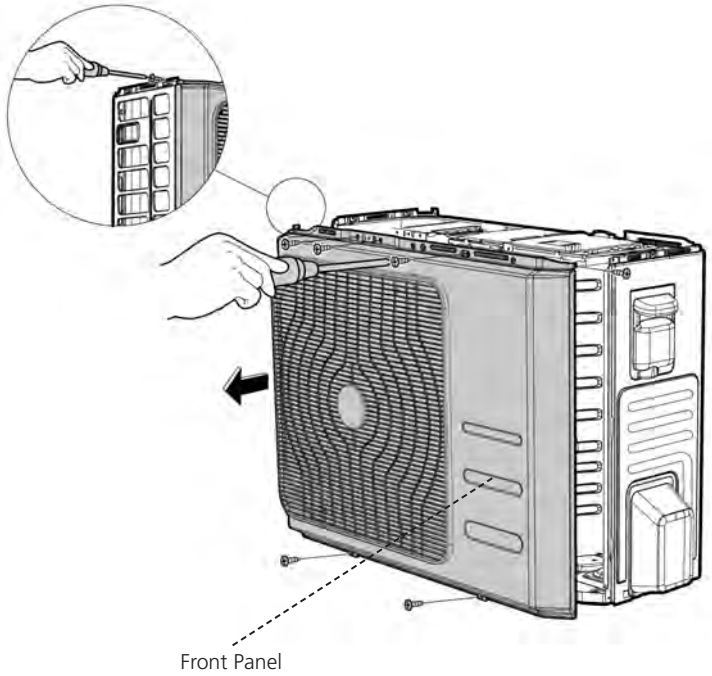 **CJ_CA30_003**
5) Remove the screws of water collecting cover and then remove the water collecting cover (1 screw) (see CJ_CA30_004).	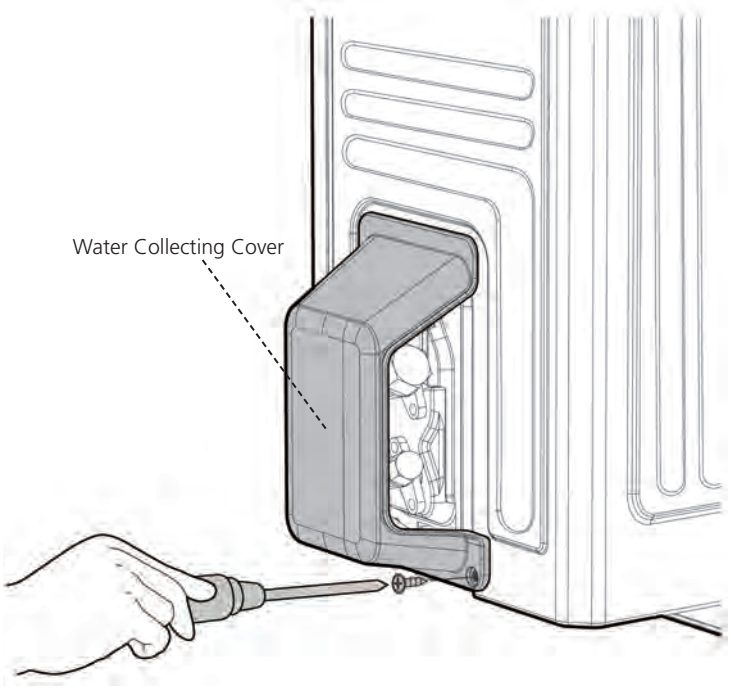 **CJ_CA30_004**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
6) Remove the screws of the right panel and then remove the right panel (6 screws) (see CJ_CA30_005).	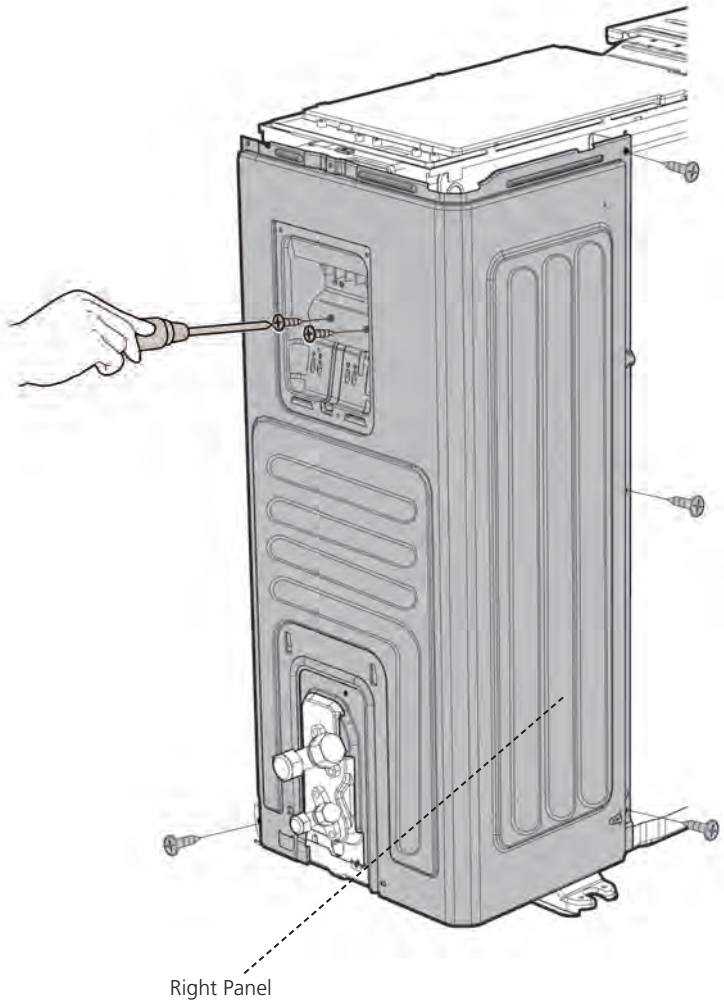 **CJ_CA30_005**

Note: This section is for reference only. Actual unit appearance may vary.

2. Fan disassembly

Note: Remove the panel plate and (refer to 1. Panel plate) before disassembling fan.

MRFOC12DS; MRFOC18DS

Procedure	Illustration
1) Remove the nut securing the fan with a spanner (see CJ_ODU_001). 2) Remove the fan.	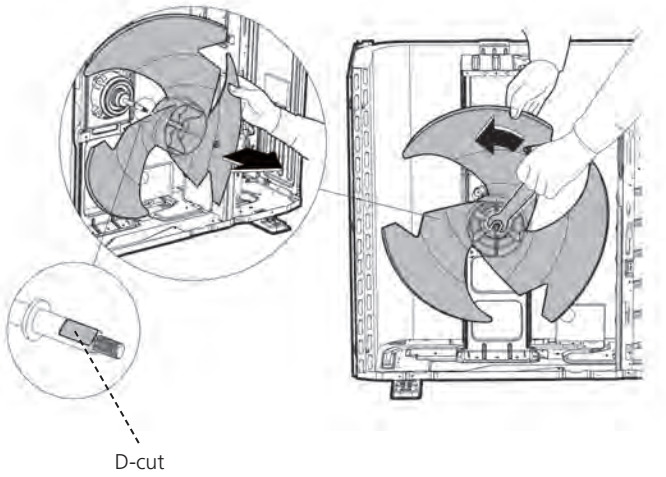 **CJ_ODU_001**
3) Disconnect the connectors for fan motor. (Blue wire, yellow wire, red wire, brown wire and black wire. The blue wire and red wire are on the capacitor. The black wire connects with terminal 4.) (see CJ_ODU_002)	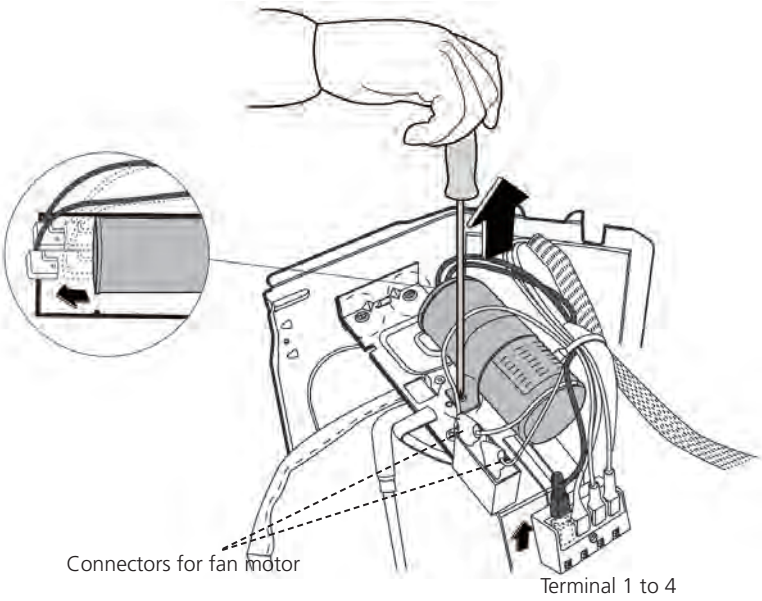 **CJ_ODU_002**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
4) Remove the fixing screws of the fan motor (4 screws) (see CJ_ODU_003). 5) Remove the fan motor.	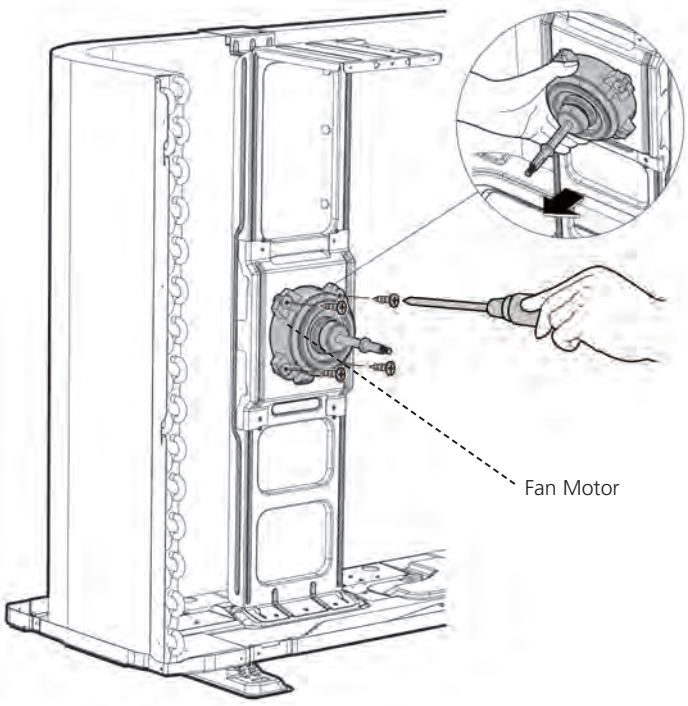 **CJ_ODU_003**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
1) Remove the nut securing the fan with a spanner (see CJ_ODU_004). 2) Remove the fan.	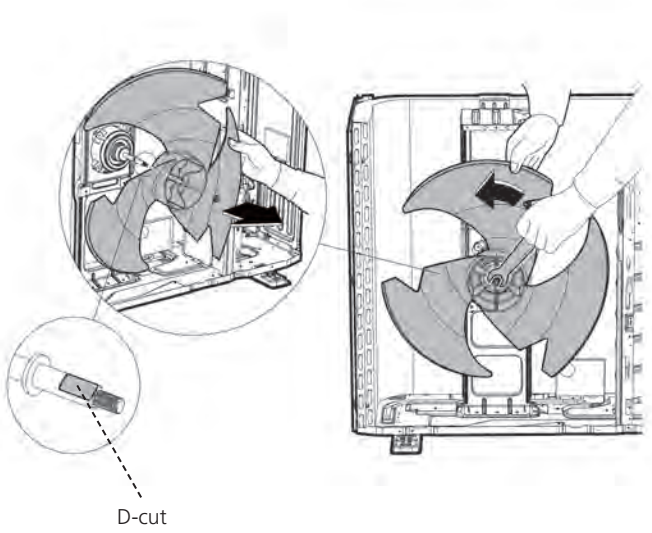 **CJ_ODU_004**
3) Disconnect the connectors for fan motor. (Blue wire, red wire, brown wire and black wire. The blue wire and brown wire are on the capacitor. The black wire connects with a terminal. And the red wire is on the borad.) (see CJ_ODU_005)	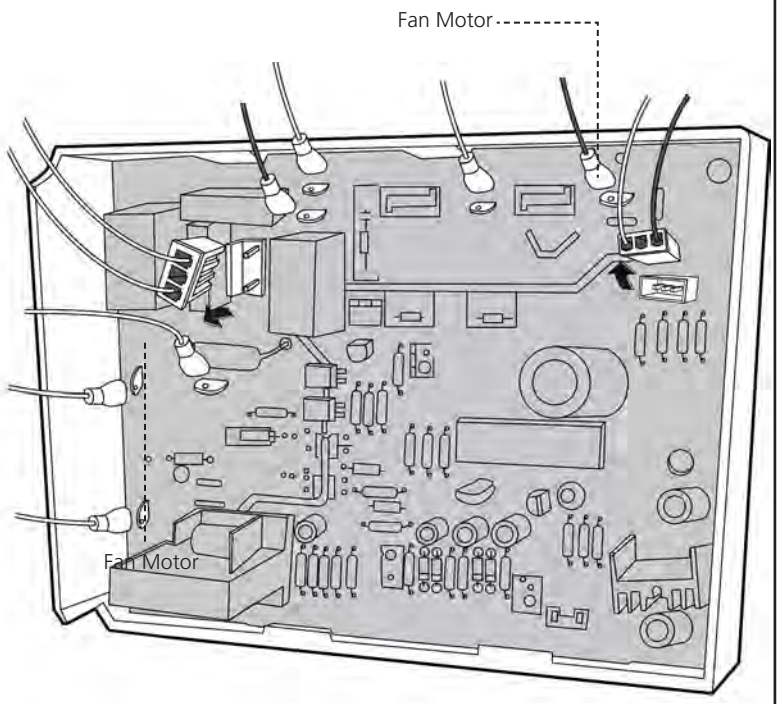 **CJ_ODU_005**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
4) Remove the fixing screws of the fan motor (4 screws) (see CJ_ODU_006). 5) Remove the fan motor.	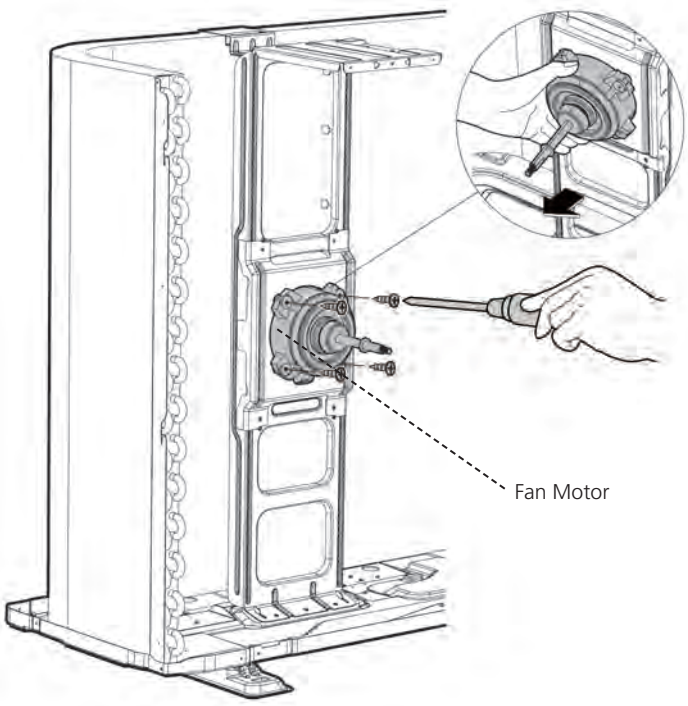 **CJ_ODU_006**

Note: This section is for reference only. Actual unit appearance may vary.

3. Electrical parts

Note: Remove the air outlet grille(refer to 1. Panel plate) before disassembling electrical parts.

MRFOC12DS; MRFOC18DS

Procedure	Illustration
1) Remove the two screws fixed the electronic control board (see CJ_ ODU_007). 2) Disconnect the wires connected to the compressor. (Black wire connects with terminal 1,blue wire and red wire connect with the compressor capacitor) (see CJ_ODU_007) 3) Disconnect the wires connected to 4-way valve.(Blue wires on terminal 2&3) (see CJ_ODU_007) 4) Remove the electrical parts (see CJ_ ODU_007). 5) Remove the fixing screw of the compressor capacitor, then pull it out (see CJ_ODU_007). 6) Disconnect the wires connected to the fan motor (see CJ_ODU_007).	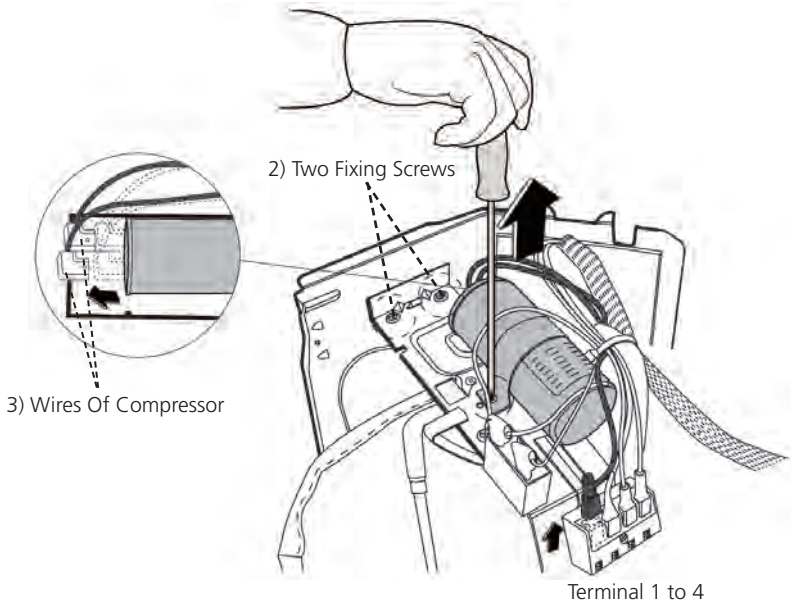 **CJ_ODU_007**

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
1) Disconnect the wires connected to the compressor. (Red wire connects with PCB board, others connects with terminals) (see CJ_ODU_008) 2) Disconnect the wires connected to 4-way valve. (see CJ_ODU_008) 3) Disconnect the wires connected to the transformer. (see CJ_ODU_008) 4) Disconnect the other wires connected to terminals. (see CJ_ODU_008) 5) Remove the PCB board. (see CJ_ODU_008)	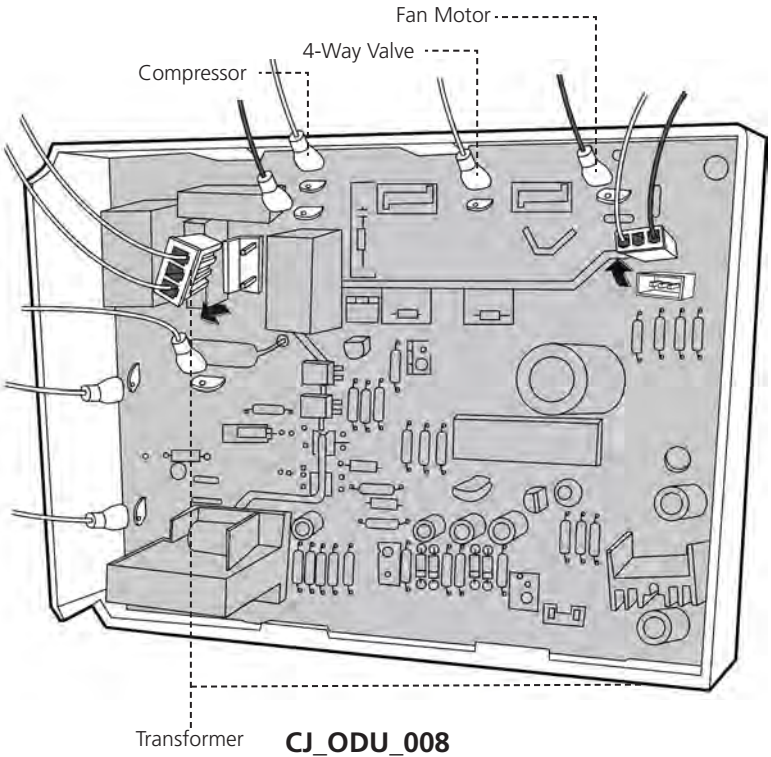 **CJ_ODU_008**
6) Remove the screws of the capacitors. (see CJ_ODU_009)	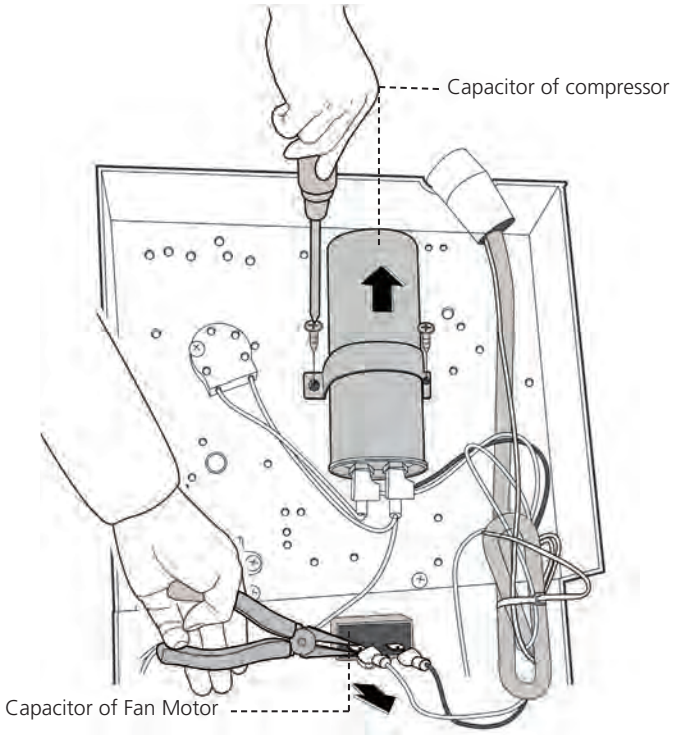 **CJ_ODU_009**

Note: This section is for reference only. Actual unit appearance may vary.

4. Sound blanket

WARNING: Recover refrigerant from the refrigerant circuit before remove the compressor.

Note: Remove the panel plate, electrical parts, and fan assembly (refer to 1. Panel plate, 2. Electrical parts, and 3. Fan assembly) before disassembling sound blanket.

Procedure	Illustration
1) Remove the sound blanket (side and top) (see CJ_ODU_010).	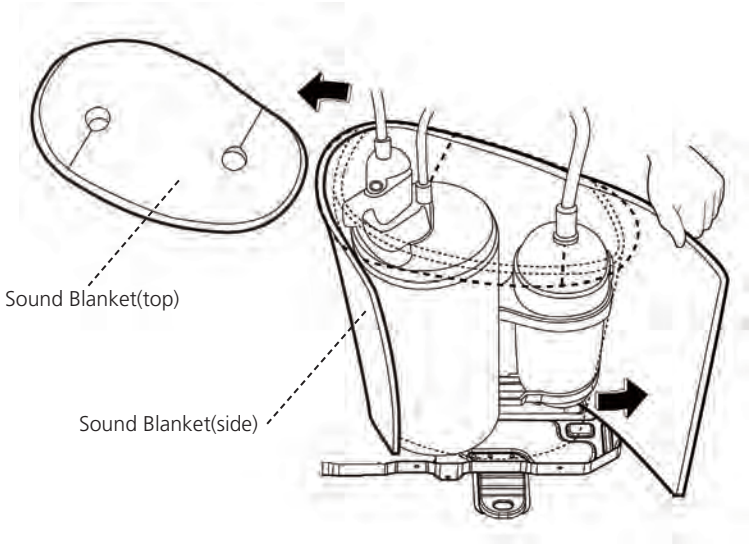 **CJ_ODU_010**

Note: This section is for reference only. Actual unit appearance may vary.

5. Compressor

WARNING: Recover refrigerant from the refrigerant circuit before remove the compressor.

Note: Remove the panel plate, electrical parts, and fan assembly (refer to 1. Panel plate, 2. Electrical parts, and 3. Fan assembly) before disassembling compressor.

Procedure	Illustration
1) Remove the flange nut of terminal cover and remove the termianal cover (see CJ_ ODU_011).	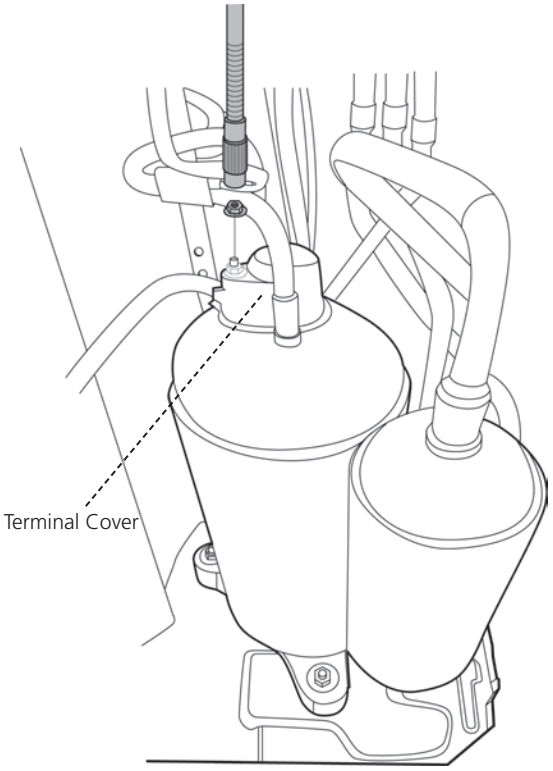 CJ_ODU_011
2) Disconnect the connectors (see CJ_ ODU_012).	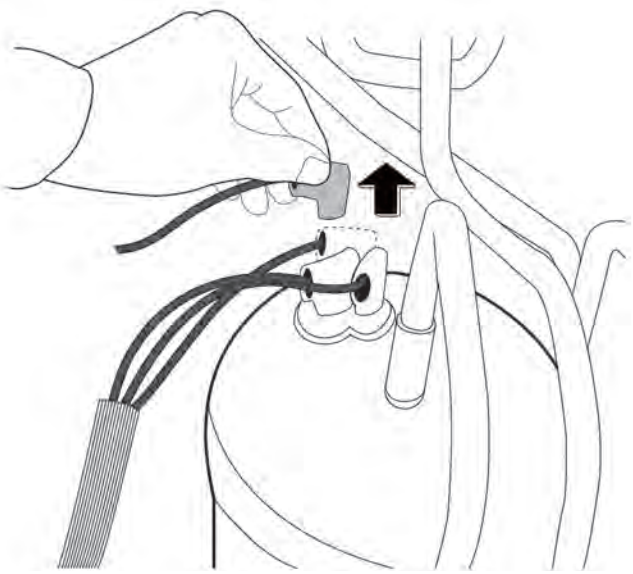 CJ_ODU_012

Note: This section is for reference only. Actual unit appearance may vary.

Procedure	Illustration
3) Remove the hex nuts and washers securing the compressor, located on the bottom plate (see CJ_ODU_013).	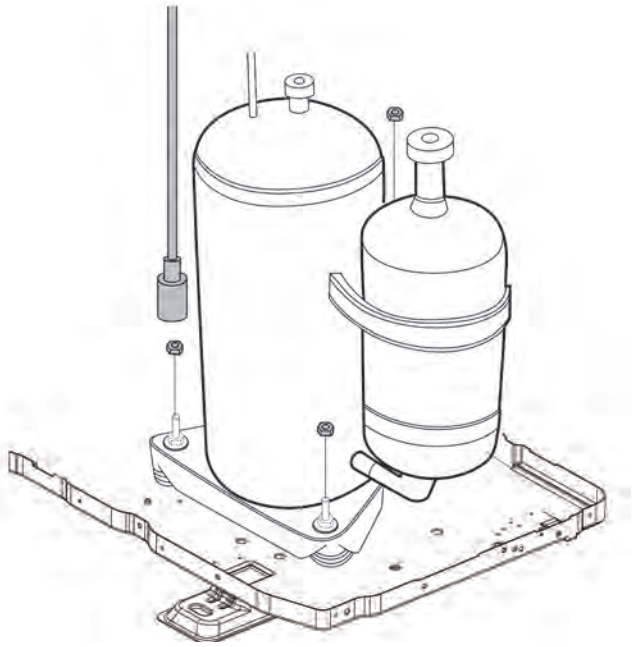 CJ_ODU_013
4) Heat up the brazed parts and then remove the the discharge pipe and the suction pipe (see CJ_ODU_014). 5) Lift the compressor from the base pan assembly with pliers.	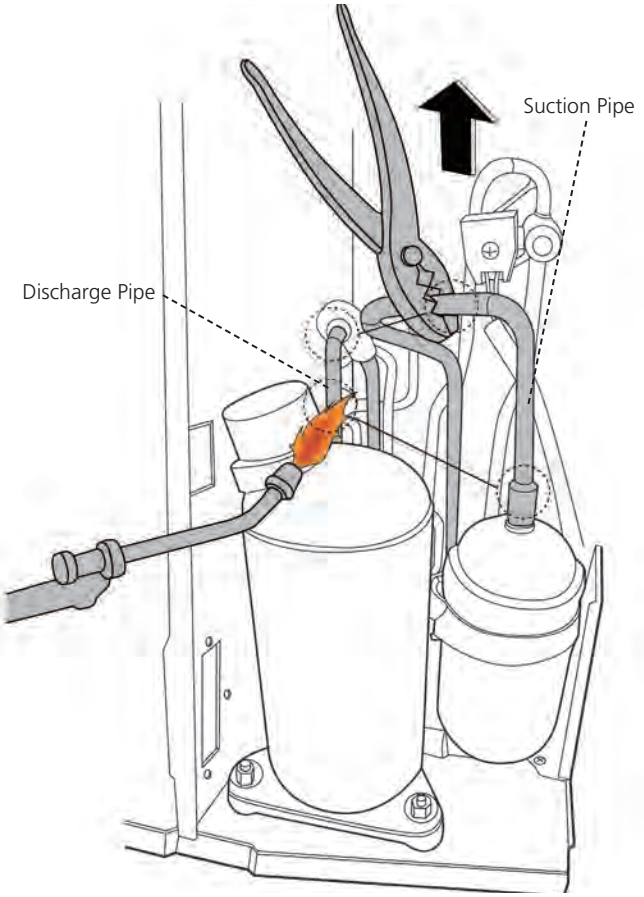 CJ_ODU_014

Note: This section is for reference only. Actual unit appearance may vary.

Troubleshooting

Contents

1. Safety Caution 49

2. General Troubleshooting 50

3. Error Diagnosis and Troubleshooting Without Error Code.....51

3.1 Remote maintenance.....51

3.2 Field maintenance 52

4. Quick Maintenance by Error Code.....53

5. Troubleshooting by Error Code.....58

5.1 Common Check Procedures.....58

5.2 E0(EEPROM parameter error) 59

5.3 E1(Indoor and outdoor unit communication error)(For MSAFD-21CRN1-QB6W, MWFOC24S).....60

5.4 E2 (Zero crossing detection error diagnosis and solution) 61

5.5 E3 (Fan speed has been out of control diagnosis and solution).....62

5.6 E4/E5 (Open circuit or short circuit of temperature sensor diagnosis and solution) 64

5.7 E7 (Indoor PCB /Display board communication error) 65

5.8 EC (Refrigerant Leakage Detection diagnosis and solution) 66

1. Safety Caution

WARNING

Electricity remains in capacitors even when the power supply is off.
Ensure the capacitors are fully discharged before troubleshooting.

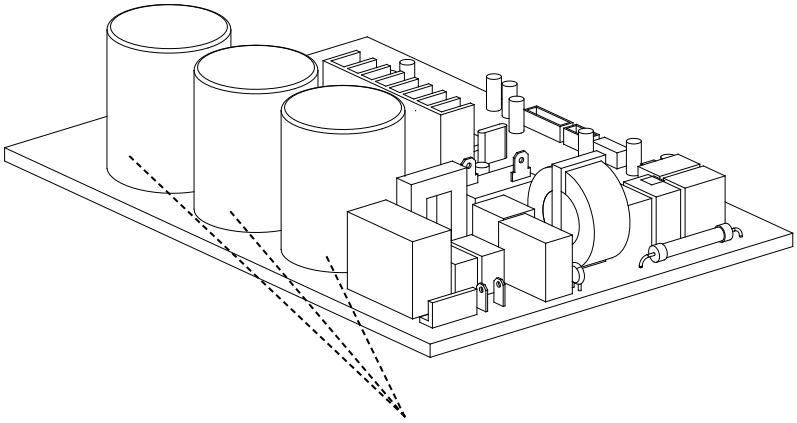

Electrolytic Capacitors

For other models, connect discharge resistance (approx.100Ω 40W) or a soldering iron plug between the positive and negative terminals of the electrolytic capacitor. The terminals are located on the bottom surface of the outdoor PCB.

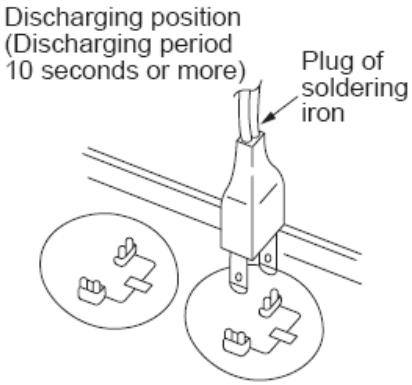

Note: This picture is for reference only. Actual appearances may vary.

2. General Troubleshooting

2.1 Error Display (Indoor Unit)

When the indoor unit encounters a recognized error, the indicator light will flash in a corresponding series, the timer display may turn on or begin flashing, and an error code will be displayed. These error codes are described in the following table:

Indicator flashes	Timer Display	Display	Error Information	Solution
1	OFF	E0	Indoor unit EEPROM parameter error	Page 59
2	OFF	E1	Indoor / outdoor units communication error(only for MSAFD-21CRN1-QB6W, MWFOC24S)	Page 60
3	OFF	E2	Zero-crossing signal detection error	Page 61
4	OFF	E3	The indoor fan speed is operating outside of the normal range	Page 62
5	OFF	E4	Indoor room temperature sensor T1 is in open circuit or has short circuited	Page 64
6	OFF	E5	Evaporator coil temperature sensor T2 is in open circuit or has short circuited	Page 64
9	OFF	E7	Indoor PCB /Display board communication error	Page 65
7	OFF	EC	Refrigerant leak detected	Page 66

For other errors:

The display board may show a garbled code or a code undefined by the service manual. Ensure that this code is not a temperature reading.

Troubleshooting:

Test the unit using the remote control. If the unit does not respond to the remote, the indoor PCB requires replacement. If the unit responds, the display board requires replacement.

3. Error Diagnosis and Troubleshooting Without Error Code

WARNING

Be sure to turn off unit before any maintenance to prevent damage or injury.

3.1 Remote maintenance

SUGGESTION: When troubles occur, please check the following points with customers before field maintenance.

	Problem	Solution
1	Unit will not start	Page 54-55
2	The power switch is on but fans will not start	Page 54-55
3	The tempreture on the playboard cannot be setted	Page 54-55
4	Unit is on but the wind is not cold(hot)	Page 54-55
5	Unit runs, but shortly stops	Page 54-55
6	The unit startup and stop frequently	Page 54-55
7	Unit runs continuously but insuffiient cooling(heating)	Page 54-55
8	Cool can not change to heat	Page 54-55
9	Unit is noisy	Page 54-55

3.2 Field maintenance

	Problem	Solution
1	Unit will not start	Page 56-57
2	Compressor will not start but fans run	Page 56-57
3	Compressor and condenser (outdoor) fan will not start	Page 56-57
4	Evaporator (indoor) fan will not start	Page 56-57
5	Condenser (Outdoor) fan will not start	Page 56-57
6	Unit runs, but shortly stops	Page 56-57
7	Compressor short-cycles due to overload	Page 56-57
8	High discharge pressure	Page 56-57
9	Low discharge pressure	Page 56-57
10	High suction pressure	Page 56-57
11	Low suction pressure	Page 56-57
12	Unit runs continuously but insuffiient cooling	Page 56-57
13	Too cool	Page 56-57
14	Compressor is noisy	Page 56-57
15	Horizontal louver can not revolve	Page 56-57

4. Quick Maintenance by Error Code

If you do not have the time to test whether specific parts are faulty, you can directly change the required parts according the error code.

You can find the parts to replace by error code in the following table.

Part requiring replacement	Error Code							
	E0	E1	E2	E3	E4	E5	E7	EC
Indoor PCB	✓	✓	✓	✓	✓	✓	✓	x
Outdoor PCB	x	✓	x	x	x	x	x	x
Indoor fan motor	x	x	x	✓	x	x	x	x
Outdoor fan motor	x	x	x	x	x	x	x	x
Temperature sensor	x	x	x	x	✓	✓	x	x
T2 Sensor	x	x	x	x	x	x	x	✓
Additional refrigerant	x	x	x	x	x	x	x	✓
Display board	x	x	x	x	x	x	✓	x

1.Remote Maintenance	Electrical Circuit							Refrigerant Circuit						
Possible causes of trouble	Power failure	The main power tripped	Loose connections	Faulty transformer	The voltage is too high or too low	The remote control is powered off	Broken remote control	Dirty air filter	Dirty condenser fins	The setting temperature is higher/lower than the room's(cooling/heating)	The ambient temperature is too high/low when the mode is cooling/heating	Fan mode	SILENCE function is activated(optional function)	Frosting and defrosting frequently
Unit will not start	☆	☆	☆	☆										
Operation is erratic, unpredictable, or unit is unresponsive														
The tempreture on the playboard cannot be setted						☆	☆							
Unit is on but the wind is not cold(hot)										☆	☆	☆		
Unit runs, but shortly stops					☆					☆	☆			
The unit startup and stop frequently					☆						☆			☆
Unit runs continuously but insufficient cooling(heating)								☆	☆	☆	☆		☆	
Cool can not change to heat														
Unit is noisy														
The unit emits a bad odor								☆						
Test method / remedy	Test voltage	Close the power switch	Inspect connections - tighten	Change the transformer	Test voltage	Replace the battery of the remote control	Replace the remote control	Clean or replace	Clean	Adjust the setting temperature	Turn the AC later	Adjust to cool mode	Turn off SILENCE function.	Turn the AC later

Check heat load				☆							Heavy load condition	Others
Tighten bolts or screws		☆									Loosen hold down bolts and / or screws	
Close all the windows and doors				☆							Bad airproof	
Remove the obstacles				☆	☆						The air inlet or outlet of either unit is blocked	
Reconnect the power or press **ON/OFF** button on remote control to restart									☆		Interference from cell phone towers and remote boosters	
Remove them		☆									Shipping plates remain attached	

2.Field Maintenance	Electrical Circuit														
Possible causes of trouble	Power failure	Blown fuse or varistor	Loose connections	Shorted or broken wires	Safety device opens	Faulty thermostat / room temperature sensor	Wrong setting place of temperature sensor	Faulty transformer	Shorted or open capacitor	Faulty magnetic contactor for compressor	Faulty magnetic contactor for fan	Low voltage	Faulty stepping motor	Shorted or grounded compressor	Shorted or grounded fan motor
Unit will not start	☆	☆	☆	☆	☆			☆							
Compressor will not start but fans run				☆		☆			☆	☆				☆	
Compressor and condenser (outdoor) fan will not start				☆		☆				☆					
Evaporator (indoor) fan will not start				☆					☆		☆				☆
Condenser (Outdoor) fan will not start				☆		☆			☆		☆				☆
Unit runs, but shortly stops										☆		☆			
Compressor short-cycles due to overload										☆		☆			
High discharge pressure															
Low discharge pressure															
High suction pressure															
Low suction pressure															
Unit runs continuously but insufficient cooling															
Too cool						☆	☆								
Compressor is noisy															
Horizontal louver can not revolve			☆	☆									☆		
Test method / remedy	Test voltage	Inspect fuse type & size	Inspect connections - tighten	Test circuits with tester	Test continuity of safety device	Test continuity of thermostat / sensor & wiring	Place the temperature sensor at the central of the air inlet grille	Check control circuit with tester	Check capacitor with tester	Test coninuity of coil & contacts	Test coninuity of coil & contacts	Test voltage	Replace the stepping motor	Check resistance with meger tester	Check resistance with meger tester

Replace the compressor														☆		Compressor stuck	Refrigerant Circuit
Leak test				☆	☆		☆		☆	☆						Shortage of refrigerant	
Replace restricted part				☆	☆					☆						Restricted liquid line	
Clean or replace				☆	☆											Dirty air filter	
Clean coil				☆	☆											Dirty evaporator coil	
Check fan				☆	☆											Insufficient air through evaporator coil	
Change charged refrigerant volume		☆				☆		☆	☆	☆						Overcharge of refrigerant	
Clean condenser or remove obstacle				☆				☆	☆	☆						Dirty or partially blocked condenser	
Purge, evacuate and recharge				☆				☆								Air or noncodensable gas in refrigerant cycle	
Remove obstruction to air folow				☆				☆								Short cycling of condensing air	
Remove obstruction in air or water flow								☆								High temperature condensing medium	
Remove obstruction in air or water flow								☆								Insufficient condensing medium	
Replace compressor		☆														Broken compressor internal parts	
Test compressor efficiency				☆		☆	☆									Inefficient compressor	
Replace valve					☆											Expansion valve obstructed	
Replace valve					☆					☆						Expansion valve or capillary tube closed completely	
Replace valve					☆					☆						Leaking power element on expansion valve	
Fix feeler bulb						☆										Poor installation of feeler bulb	
Check heat load				☆		☆										Heavy load condition	Others
Tighten bolts or screws		☆														Loosen hold down bolts and / or screws	
Remove them		☆														Shipping plates remain attached	
Choose AC of lager capacity or add the number of AC				☆												Poor choices of capacity	
Rectify piping so as not to contact each other or with external plate		☆														Contact of piping with other piping or external plate	

5. Troubleshooting by Error Code

5.1 Common Check Procedures

5.1.1 Temperature Sensor Check

Disconnect the temperature sensor from PCB, measure the resistance value with a tester.

Temperature Sensors.

Room temp.(T1) sensor,

Indoor coil temp.(T2) sensor,

Outdoor coil temp.(T3) sensor,

Outdoor ambient temp.(T4) sensor,

Measure the resistance value of each winding by using the multi-meter.

5.2 E0 (EEPROM parameter error)

Description: Indoor or outdoor PCB main chip does not receive feedback from EEPROM chip.

Recommended parts to prepare:

- Indoor PCB
- Outdoor PCB

Troubleshooting and repair:

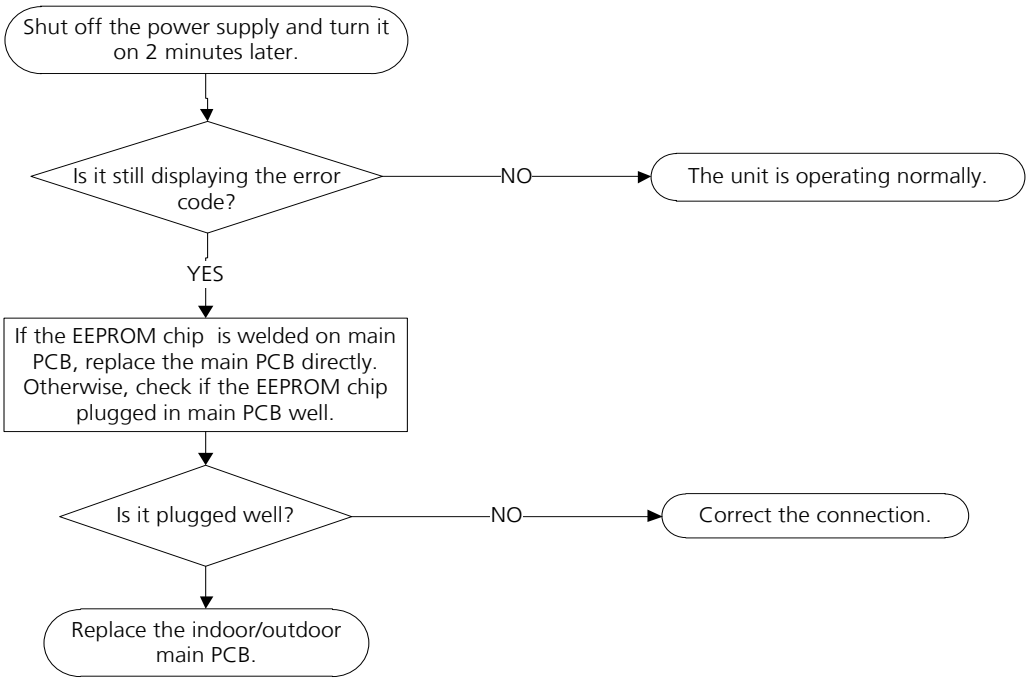

Remarks:

The location of the EEPROM chip on the indoor and outdoor PCB is shown in the following two images:

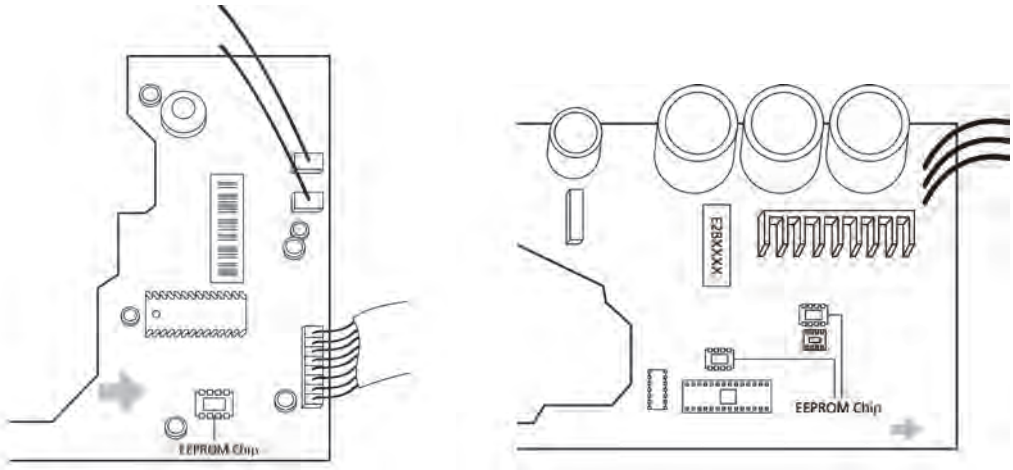

Note: These images are for reference only.

5.3 E1 (Indoor and outdoor unit communication error)(only for MWFOC24S)

Description: The indoor unit has not received feedback from the outdoor unit for 120 seconds.

Recommended parts to prepare:

- Indoor PCB
- Outdoor PCB
- Reactor

Troubleshooting and repair:

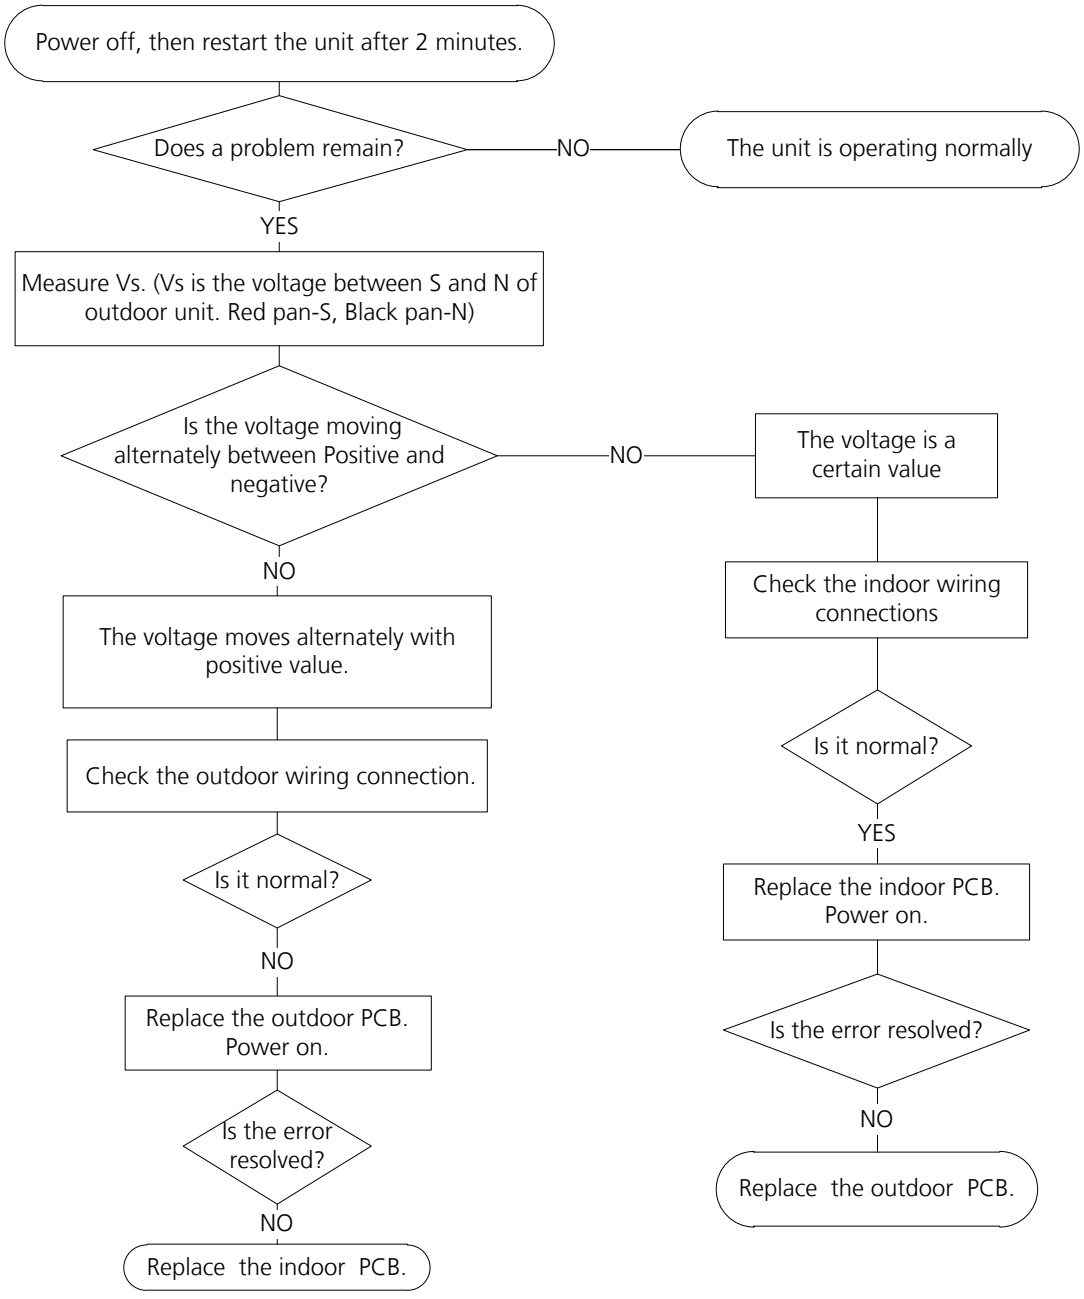

5.4 E2 (Zero crossing detection error diagnosis and solution)

Description: When PCB does not receive zero crossing signal feedback for 4 minutes or the zero crossing signal time interval is abnormal.

Recommended parts to prepare:

- Connection mistake
- PCB faulty

Troubleshooting and repair:

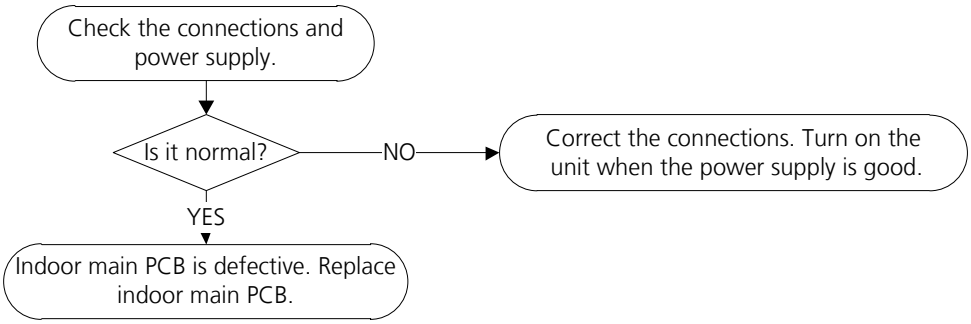

5.5 E3(Fan speed has been out of control diagnosis and solution)

Description: When indoor fan speed keeps too low (300RPM) for certain time, the unit will stop and the LED will display the failure.

Recommended parts to prepare:

- Wiring mistake
- Faulty fan assembly'y faulty
- Faulty fan motor
- Faulty PCB

Troubleshooting and repair:

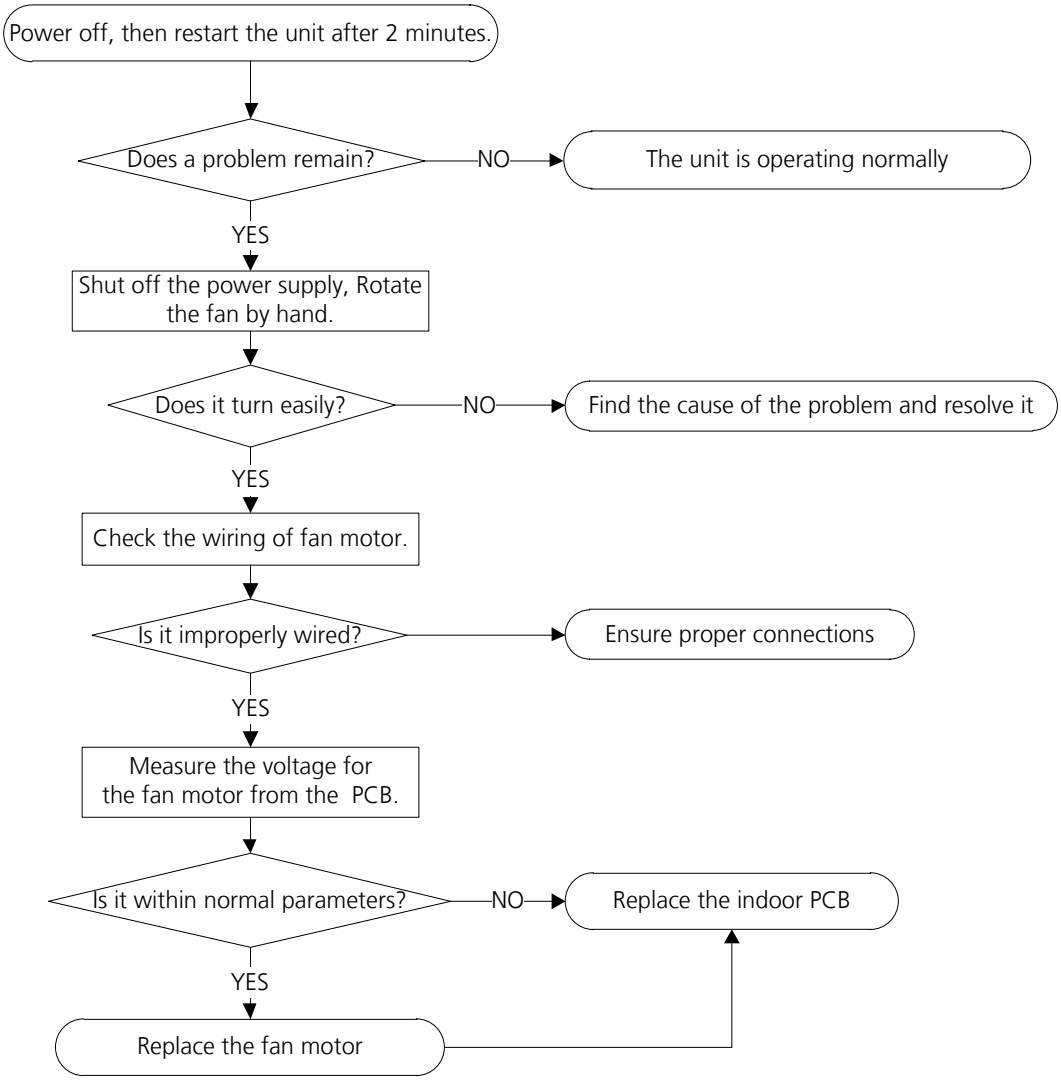

Index:

1. Indoor AC Fan Motor

Power on and set the unit running in fan mode at high fan speed. After running for 15 seconds, measure the voltage of pin1 and pin2. If the value of the voltage is less than 100V(208~240V power supply) or 50V(115V power supply), the PCB must has problems and need to be replaced.

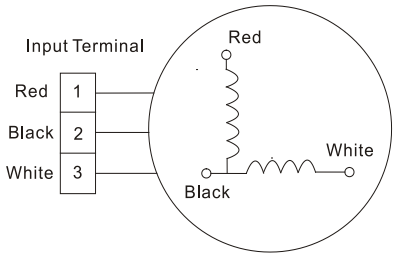

5.6 E4/E5 (Open circuit or short circuit of temperature sensor diagnosis and solution)

Description: If the sampling voltage is lower than 0.06V or higher than 4.94V, the LED will display the failure.

Recommended parts to prepare:

- Wiring mistake
- Faulty sensor
- Faulty PCB

Troubleshooting and repair:

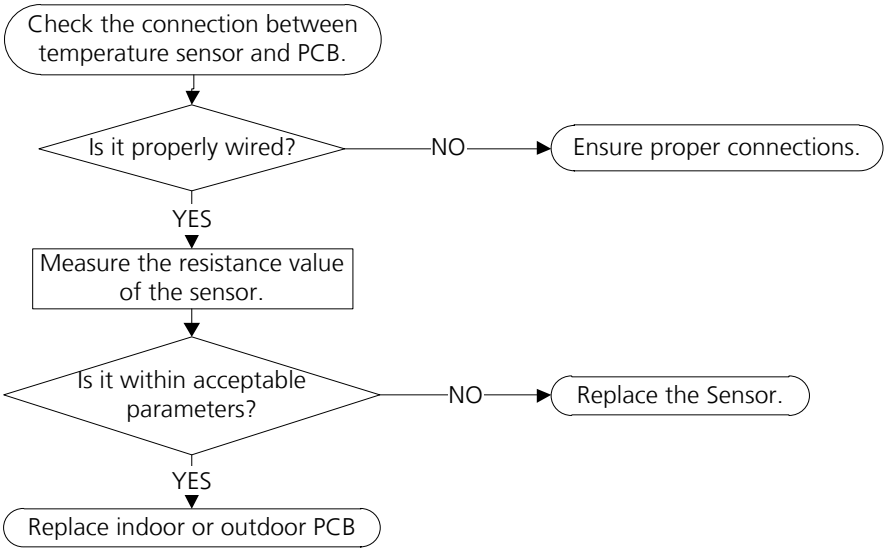

5.7 E7 (Indoor PCB /Display board communication error)

Description: Indoor PCB does not receive feedback from Display board.

Recommended parts to prepare:

- Wiring mistake
- Faulty PCB
- Display board malfunction

Troubleshooting and repair:

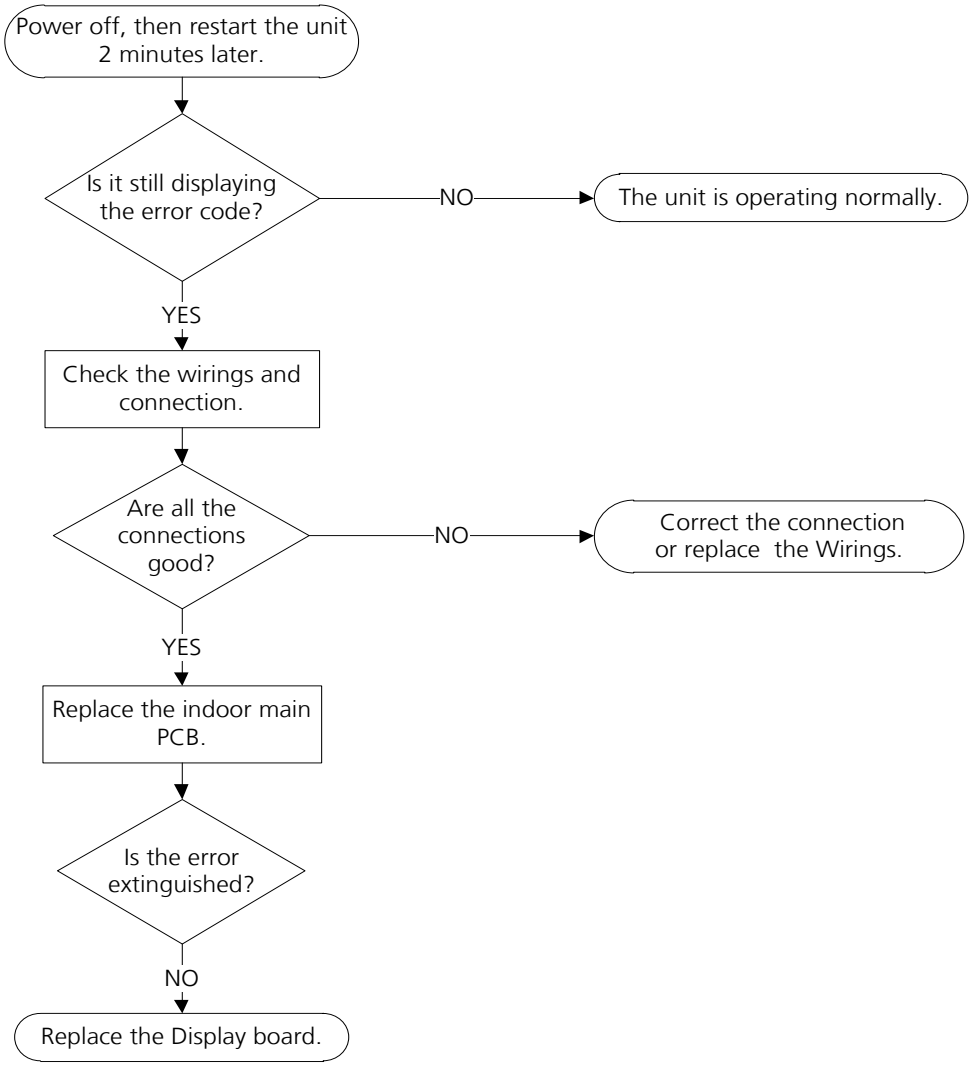

5.8 EC (Refrigerant Leakage Detection diagnosis and solution)

Description: Define the evaporator coil temp.T2 of the compressor just starts running as Tcool.

In the beginning 5 minutes after the compressor starts up, if T2<Tcool-2°C does not keep continuous 4 seconds and this situation happens 3 times, the display area will show "EC" and AC will turn off.

Recommended parts to prepare:

- Faulty T2 sensor
- Faulty iIndoor PCB
- System problems, such as leakage or blockages

Troubleshooting and repair:

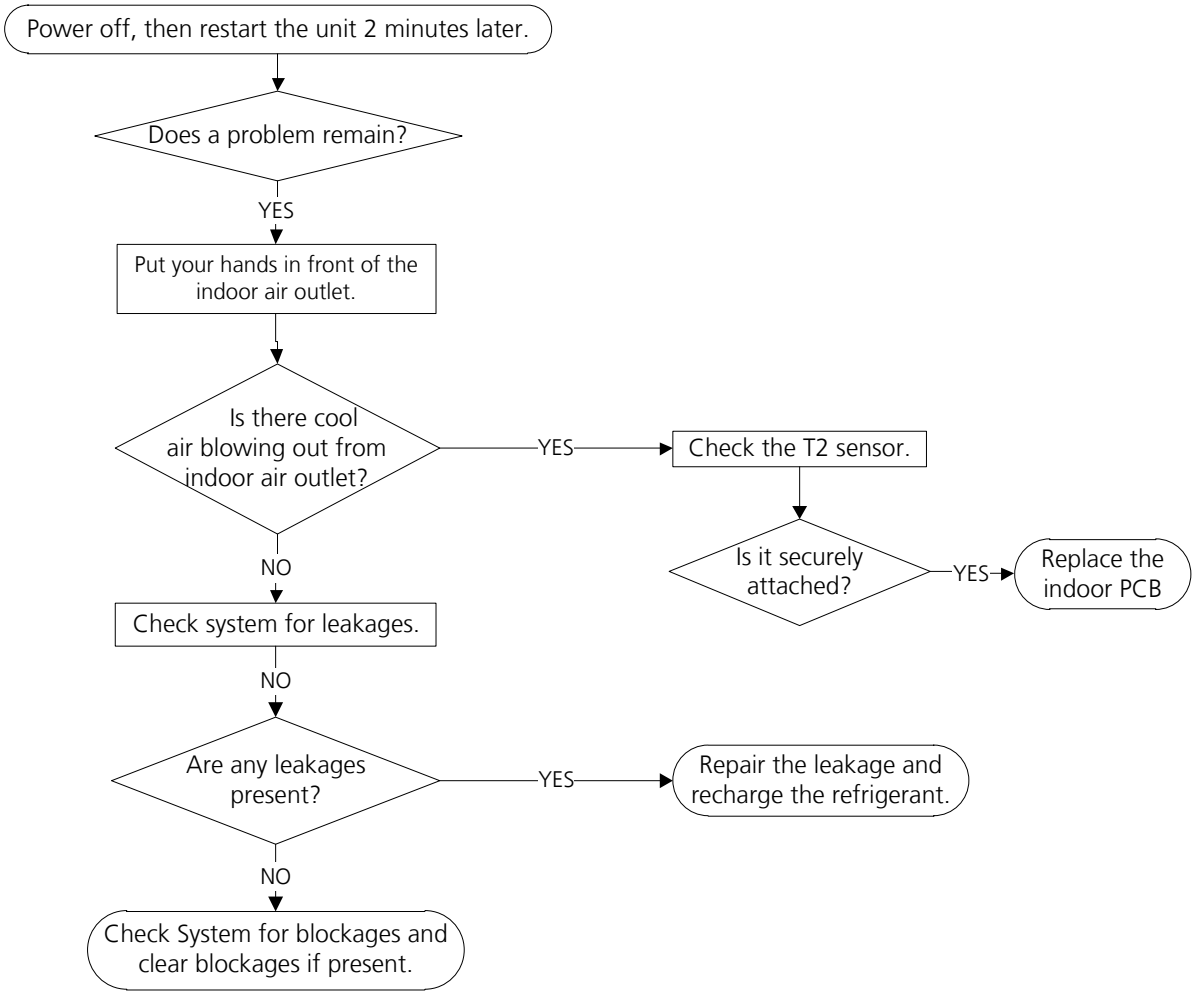

Contents

i) Temperature Sensor Resistance Value Table for T1, T2, T3, and T4 (°C – K) 68

i) Temperature Sensor Resistance Value Table for T1,T2,T3 and T4 (°C – K)

°C	°F	K Ohm	°C	°F	K Ohm	°C	°F	K Ohm	°C	°F	K Ohm
-20	-4	115.266	20	68	12.6431	60	140	2.35774	100	212	0.62973
-19	-2	108.146	21	70	12.0561	61	142	2.27249	101	214	0.61148
-18	0	101.517	22	72	11.5	62	144	2.19073	102	216	0.59386
-17	1	96.3423	23	73	10.9731	63	145	2.11241	103	217	0.57683
-16	3	89.5865	24	75	10.4736	64	147	2.03732	104	219	0.56038
-15	5	84.219	25	77	10	65	149	1.96532	105	221	0.54448
-14	7	79.311	26	79	9.55074	66	151	1.89627	106	223	0.52912
-13	9	74.536	27	81	9.12445	67	153	1.83003	107	225	0.51426
-12	10	70.1698	28	82	8.71983	68	154	1.76647	108	226	0.49989
-11	12	66.0898	29	84	8.33566	69	156	1.70547	109	228	0.486
-10	14	62.2756	30	86	7.97078	70	158	1.64691	110	230	0.47256
-9	16	58.7079	31	88	7.62411	71	160	1.59068	111	232	0.45957
-8	18	56.3694	32	90	7.29464	72	162	1.53668	112	234	0.44699
-7	19	52.2438	33	91	6.98142	73	163	1.48481	113	235	0.43482
-6	21	49.3161	34	93	6.68355	74	165	1.43498	114	237	0.42304
-5	23	46.5725	35	95	6.40021	75	167	1.38703	115	239	0.41164
-4	25	44	36	97	6.13059	76	169	1.34105	116	241	0.4006
-3	27	41.5878	37	99	5.87359	77	171	1.29078	117	243	0.38991
-2	28	39.8239	38	100	5.62961	78	172	1.25423	118	244	0.37956
-1	30	37.1988	39	102	5.39689	79	174	1.2133	119	246	0.36954
0	32	35.2024	40	104	5.17519	80	176	1.17393	120	248	0.35982
1	34	33.3269	41	106	4.96392	81	178	1.13604	121	250	0.35042
2	36	31.5635	42	108	4.76253	82	180	1.09958	122	252	0.3413
3	37	29.9058	43	109	4.5705	83	181	1.06448	123	253	0.33246
4	39	28.3459	44	111	4.38736	84	183	1.03069	124	255	0.3239
5	41	26.8778	45	113	4.21263	85	185	0.99815	125	257	0.31559
6	43	25.4954	46	115	4.04589	86	187	0.96681	126	259	0.30754
7	45	24.1932	47	117	3.88673	87	189	0.93662	127	261	0.29974
8	46	22.5662	48	118	3.73476	88	190	0.90753	128	262	0.29216
9	48	21.8094	49	120	3.58962	89	192	0.8795	129	264	0.28482
10	50	20.7184	50	122	3.45097	90	194	0.85248	130	266	0.2777
11	52	19.6891	51	124	3.31847	91	196	0.82643	131	268	0.27078
12	54	18.7177	52	126	3.19183	92	198	0.80132	132	270	0.26408
13	55	17.8005	53	127	3.07075	93	199	0.77709	133	271	0.25757
14	57	16.9341	54	129	2.95896	94	201	0.75373	134	273	0.25125
15	59	16.1156	55	131	2.84421	95	203	0.73119	135	275	0.24512
16	61	15.3418	56	133	2.73823	96	205	0.70944	136	277	0.23916
17	63	14.6181	57	135	2.63682	97	207	0.68844	137	279	0.23338
18	64	13.918	58	136	2.53973	98	208	0.66818	138	280	0.22776
19	66	13.2631	59	138	2.44677	99	210	0.64862	139	282	0.22231